

HyResponse

BASICS OF HYDROGEN SAFETY FOR FIRST RESPONDERS

Lecture. Dealing with hydrogen explosions



Content

- Objectives
- Classification of explosions
- Terminology
- Deflagrations
- Deflagration-to-detonation transition (DDT)
- Detonations
- The effects of blast waves on people and buildings
- Explosion prevention and mitigation


Objectives of the lecture

By the end of this lecture a First Responder/a trainee will be able to:

- Distinguish between deflagrations and detonations
- Recognise the severe consequences of deflagrations and detonations
- Point out the main features of deflagrations and detonations
- Make a distinction between deflagrations in the open and in confined spaces
- Explain deflagration-to-detonation transition (DDT) phenomenon
- Evaluate the effect of blast waves caused by a rupture of a storage tank (in afire) on people and building structures with the use of nomograms
- Explain the vented deflagration as a main mitigation technique
- Recognise the effects of missiles and debris from explosions
- State the main prevention and suggest possible mitigation measures for explosion events.



Classification of explosions (Crowl, 2003)

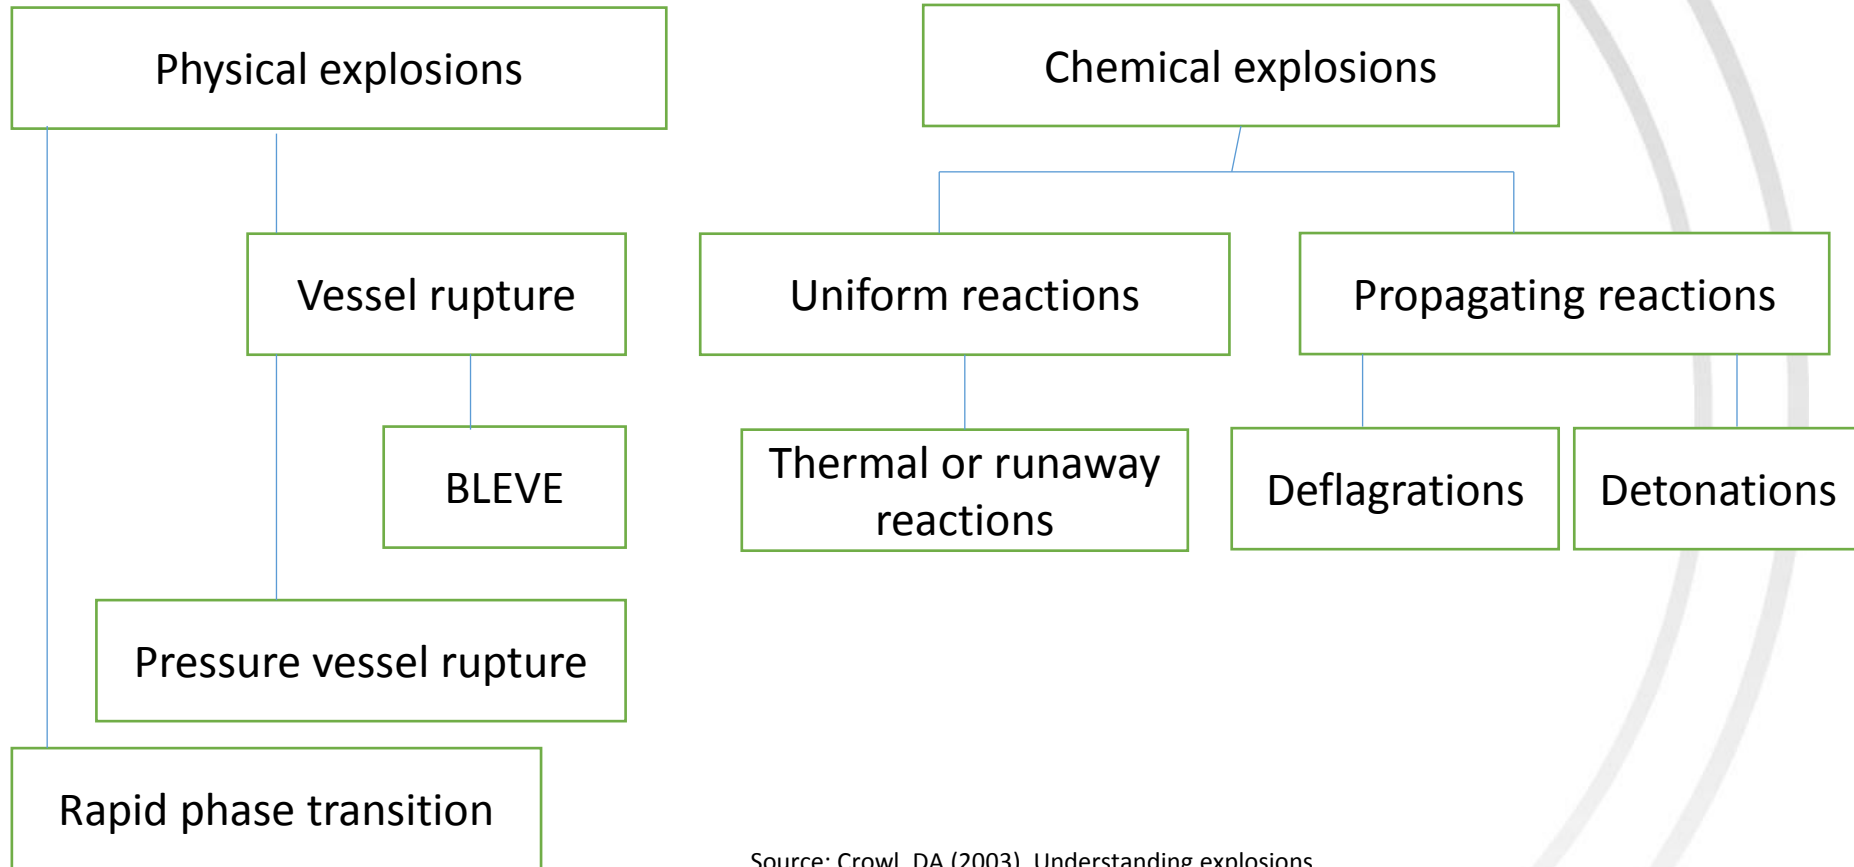

Source: Crowl, DA (2003). Understanding explosions.

Terminology

- 'Chemical' explosions: deflagrations and detonations
- 'Physical' explosions: occur on vessels due to a sudden release of mechanical energy.
- **Deflagration** is the phenomenon of a combustion zone propagation at the velocity lower than the speed of sound (sub-sonic) into a fresh, unburned mixture.
- **Detonation** is the process of combustion zone propagating at the velocity higher than the speed of sound (supersonic) in the unreacted mixture.
- Deflagration propagates with a velocity below the speed of sound in the unburnt mixture, while **detonation** - with velocity above the speed of sound. Detonation propagates 2-3 order of magnitudes faster than deflagration and results in pressures at the detonation front 15-20 times higher than initial pressure.



Backdraft



Deflagrations and detonations

- Deflagrations in the open, in the absence of any obstacles, could generate overpressures (pressure above atmospheric pressure) of about 10 kPa.
- Deflagrations in the enclosures and/or confined spaces could lead to more significant overpressures. During deflagration the pressure grows practically uniformly within an enclosure.
- Deflagration in an enclosure can be mitigated by **venting**, the most cost-effective and widespread explosion mitigation technique.
- Detonation is a coupled shock and flame front structure which propagates with supersonic velocity. The speed of detonation wave depends on the stoichiometry of hydrogen-air mixture and ranges from **1,600 to 2,000 m/s**. The overpressures also much higher: **1,000-1,500 kPa**.
- Venting technique is not applicable to detonations as the pressure arrives to any location and affects a system and/or structural elements simultaneously with the detonation wave, i.e. there is no time to “release” the pressure.



General features of deflagrations and detonations

- The stoichiometric hydrogen-air mixture, flame propagation velocity during deflagration in the open quiescent atmosphere in a 20 m diameter: hemi-spherical cloud is growing up to its maximum velocity of **84 m/s**, and an explosion overpressure is of the order of **10 kPa** in the near field. Then, pressure in a blast wave decays inversely proportional to the radius (for high explosives the pressure decays inversely proportional to radius squared).
- The ratio of maximum deflagration pressure to initial pressure in a closed vessel is essentially higher than 0.1 (=10 kPa/100 kPa).
- Detonation propagates faster than the speed of sound with the Chapman-Jouguet (CJ) velocity and the CJ pressure, which for stoichiometric hydrogen-air mixture are **1,968 m/s** and **1.56 MPa**, respectively.



Factors affecting the severity of deflagrations

- The composition of hydrogen-oxidizer mixture
- The uniformity of hydrogen-oxidizer mixture (for the same 'm')
- The level of confinement (walls and ceiling)
- The presence of obstacles

Detonation parameters

- Dimensionless detonation pressure (P_1/P_0 , equilibrium CJ values) and temperature (T_1/T_0) for hydrogen-air and hydrogen-oxygen mixtures are given in the Table below. The P_1/P_0 and T_1/T_0 ratios give the pressure and temperature rise across the detonation shock .

H ₂ concentration, % v/v	T ₀ , K	P ₀ , kPa	T ₁ /T ₀	P ₁ /P ₀	T ₀ , K	P ₀ , kPa	T ₁ /T ₀	P ₁ /P ₀
Hydrogen-air mixture								
18.3	298	101.3	7.657	12.154	298	10.1	7.580	12.111
25	298	101.3	9.257	14.605	298	10.1	8.870	14.223
50	298	101.3	8.706	13.713	298	10.1	8.482	13.555
59	298	101.3	7.678	12.144	298	10.1	7.601	12.119
Hydrogen-oxygen mixture								
5	298	101.3	3.118	4.880	298	10.1	3.119	4.882
25	298	101.3	9.034	14.289	298	10.1	8.660	13.896
50	298	101.3	11.646	17.857	298	10.1	10.537	16.616
75	298	101.3	12.111	18.671	298	10.1	10.834	17.250
90	298	101.3	8.576	13.584	298	10.1	8.327	13.393



Consequences of explosions

- [Propane fire and explosions, Dallas](#)
- [Explosion at a chemical plant producing rocket fuel, Nevada](#)
- [Fire and explosion \(domino effect\) at a cracking unit on a refinery site \(3rd September 2000, Gonfreville l'Orcher, Havre, France\).](#)
- [Explosion and fire at a chemical plant \(8th June 1988, Auzouer-en-Touraine, France\)](#)
- [Massive explosion at a polyethylene production plant \(23rd October 1989, Pasedena, Texas, USA\)](#)
- Pressurized hydrogen tank rupture: a tank containing 100m³ of hydrogen at 45 bar pressure burst without any apparent reason (1991, Hanau, Frankfurt, Germany)



Source: www.H2tools.org




Source : SDIS



Source : Presse Paris Normandie

Closed vessel deflagrations

Deflagration pressure of hydrogen-air and hydrogen-oxygen in a closed vessel at NTP

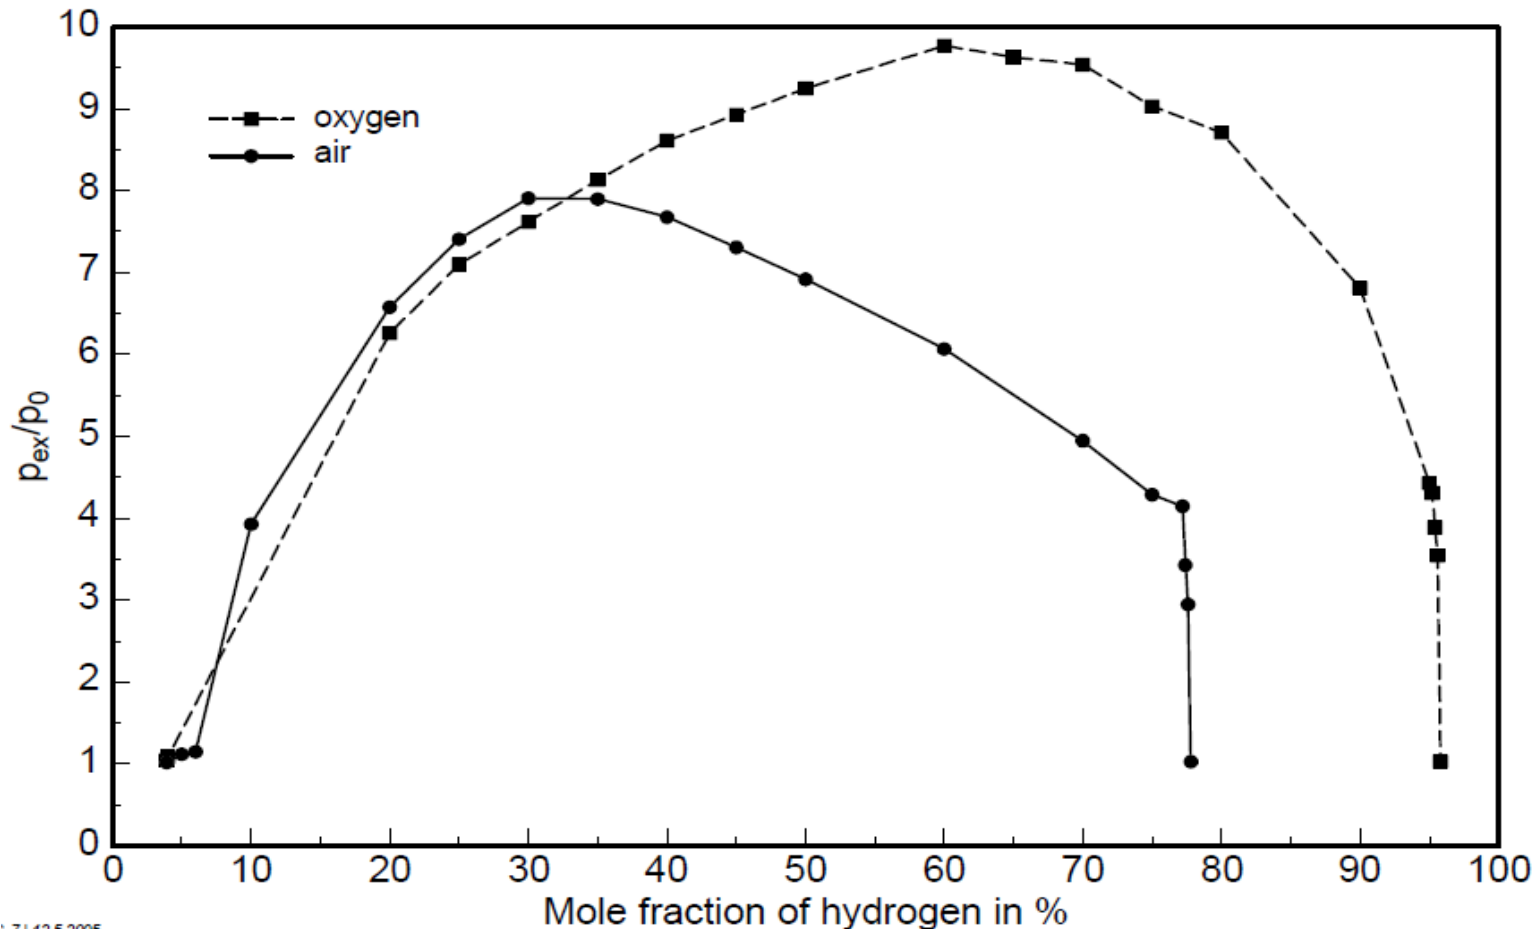


7/12/2005

Source:

Jordan, T. Overview of hydrogen and fuel cell technologies. 1st ISCARW "Progress in Hydrogen Safety", September 2008, University of Ulster, Belfast


Closed vessel – quiescent mixture

- Quiescent mixtures <8 vol. % generate no pressure

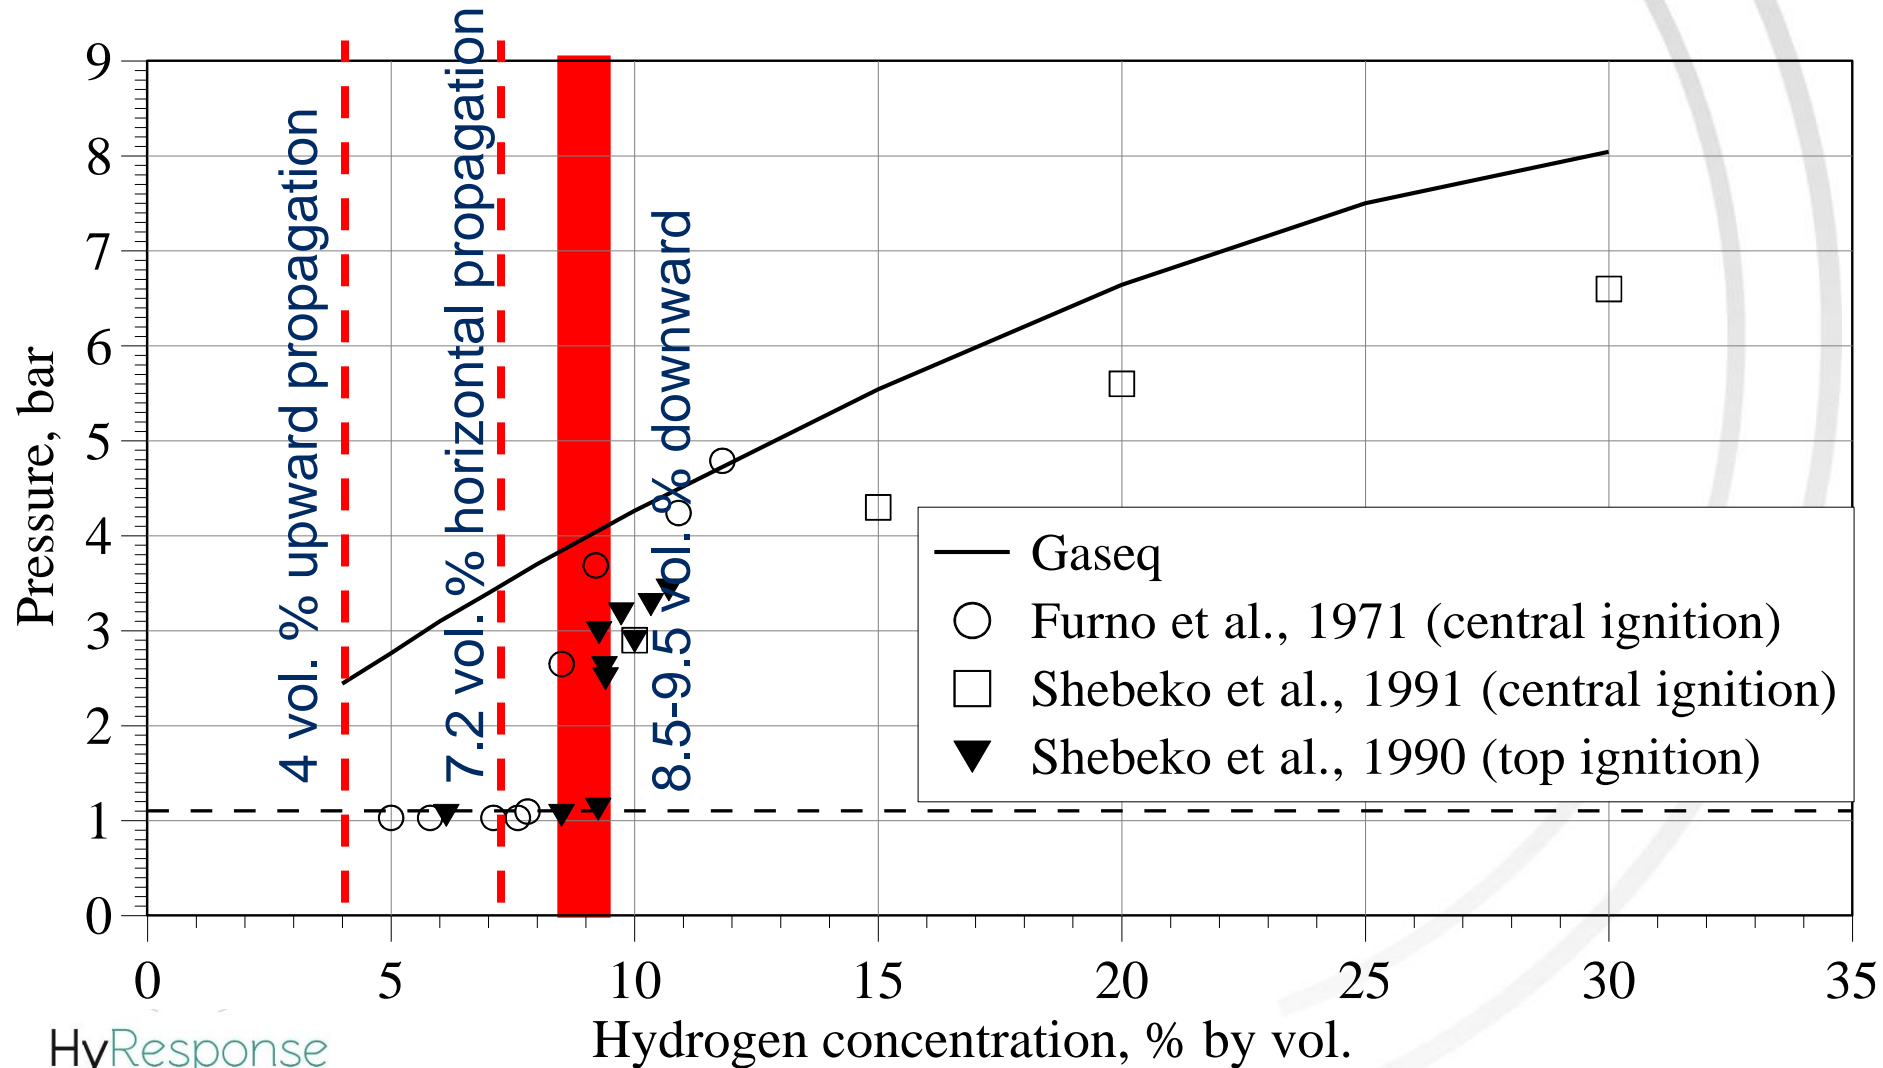


Hydrogen-air deflagrations in the open atmosphere


A series of experiments with near stoichiometric hydrogen-air deflagrations in unconfined hemispherical volumes was performed by Pfortner and Schneider (1983) in the Fraunhofer Institute for Fuels and Explosive Materials.



3.06 m

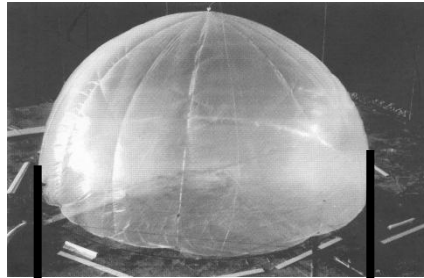

10 m

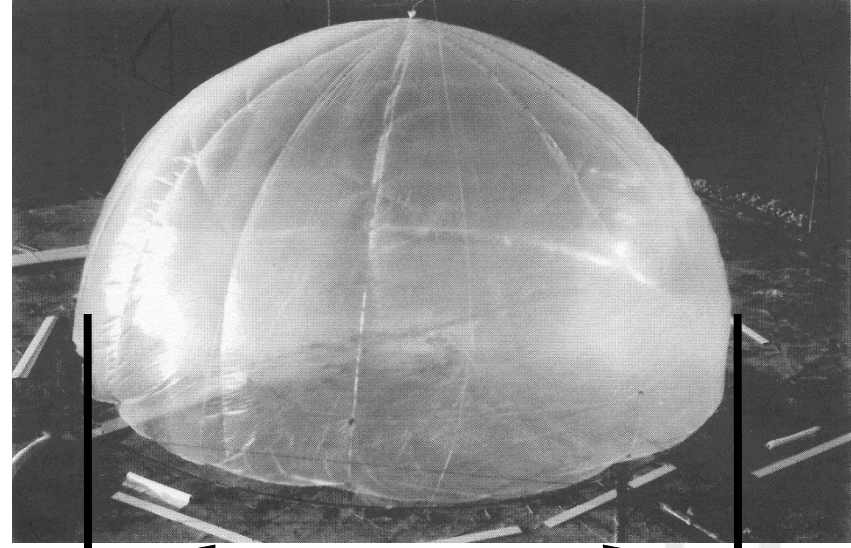


20 m

Test No.	D_b , m	V , m ³	C , % vol.	T_i , K	p_i , kPa	E_{ign} , J	S_{ui}^{exp} , m/s	χ_{max}^{exp} , m/s	w_{max}^{exp} , m/s
GHT 26	3.06	7.5	29.2	281	99.06	1000	2.32	2.55	43
GHT 11	10.00	262	31.0	281	100.66	314	2.50	3.32	60
GHT 34*	20.00	2094	29.7	283	98.93	150	2.39	4.84	84


* - Experiments with wire net over the hemispherical balloon.

The largest hydrogen-air deflagration test

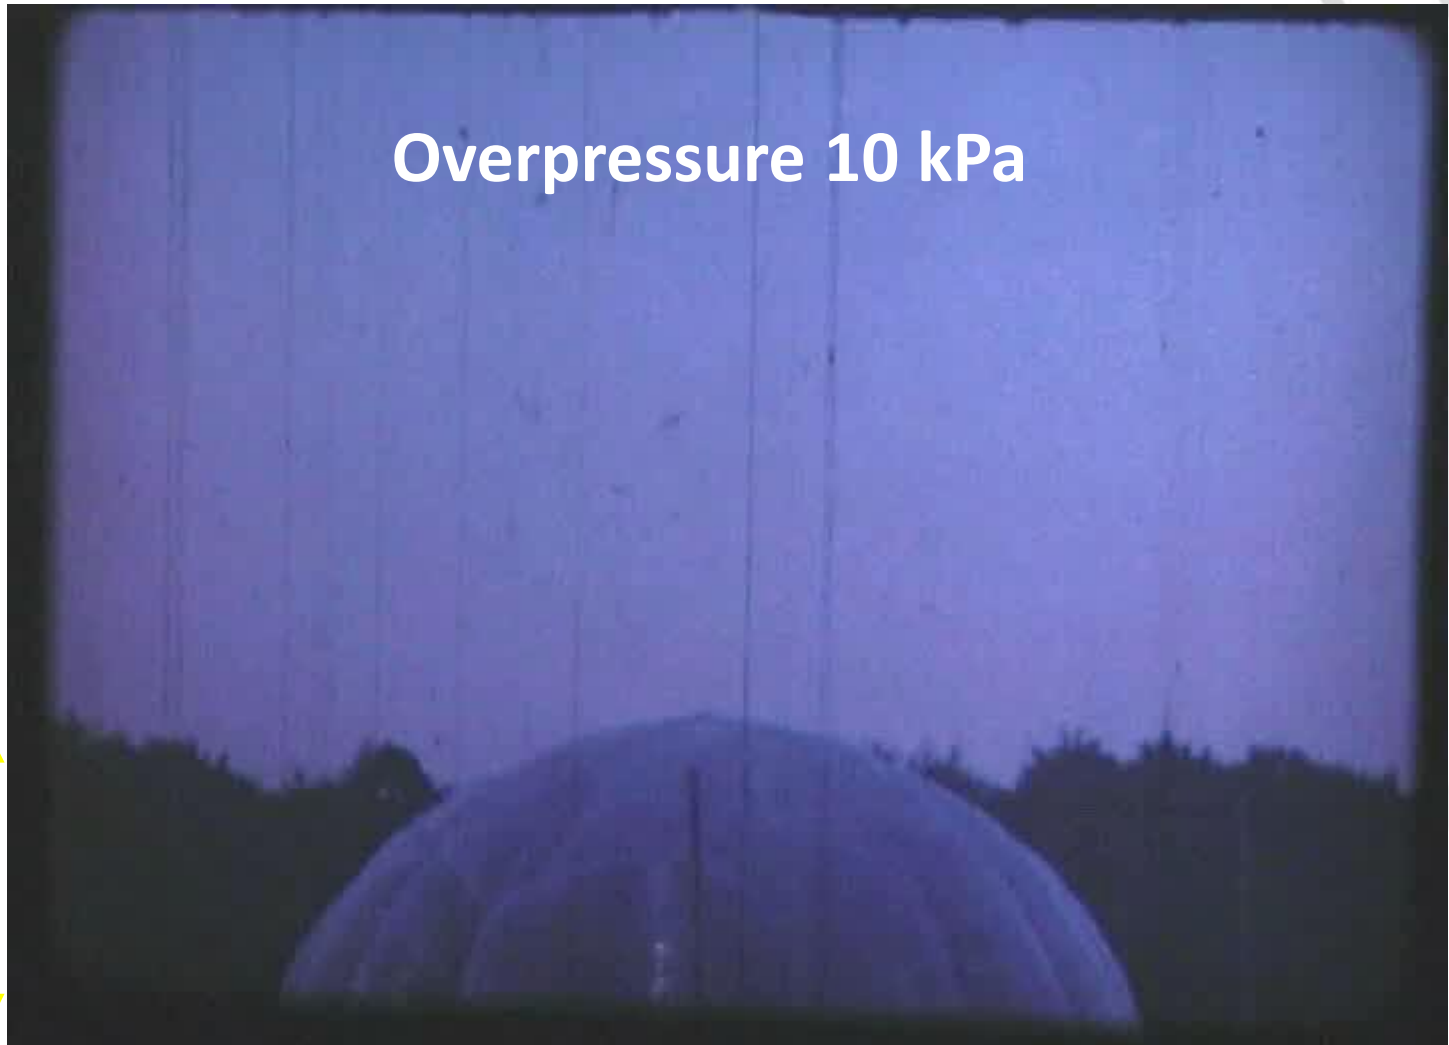

Overpressure 10 kPa


10 m



HyResponse





20 m

LES of the open atmosphere test

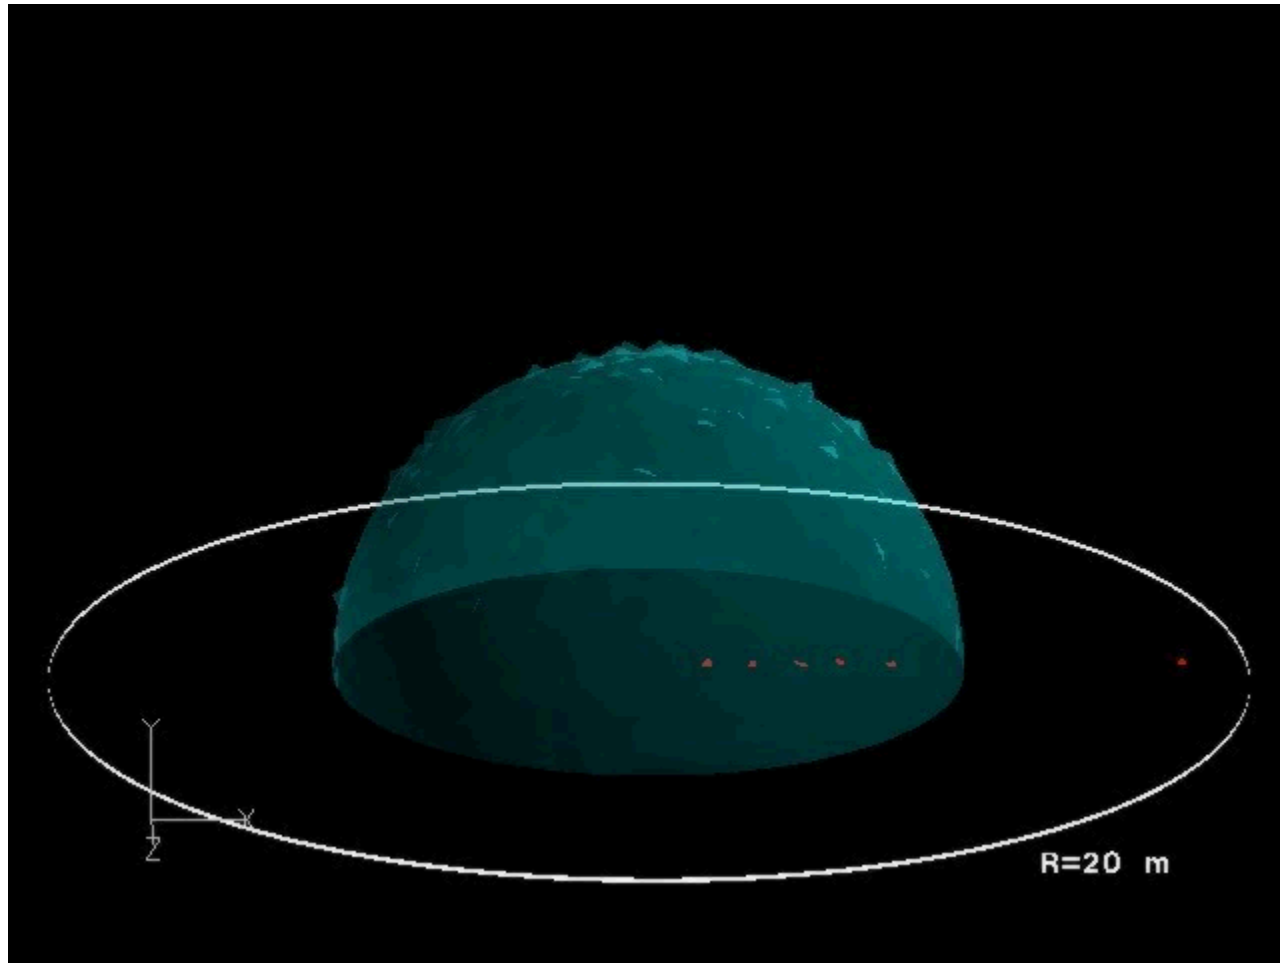


The open atmosphere

Hemisphere 10 m diameter (Fraunhofer ICT)

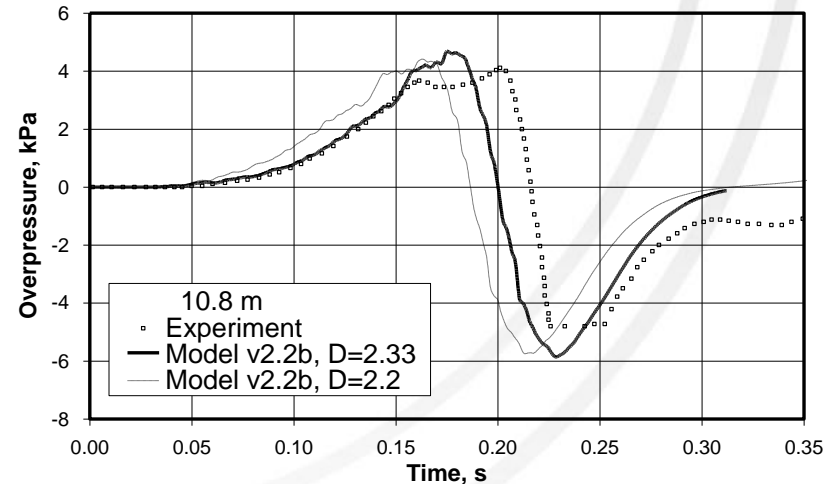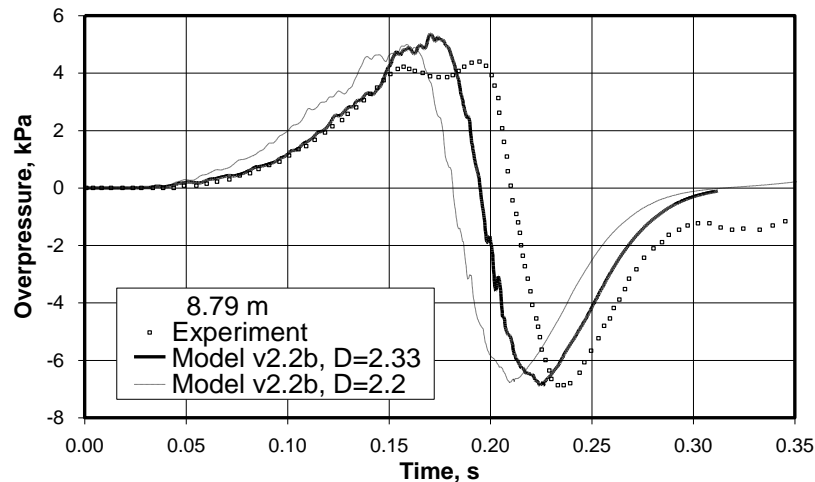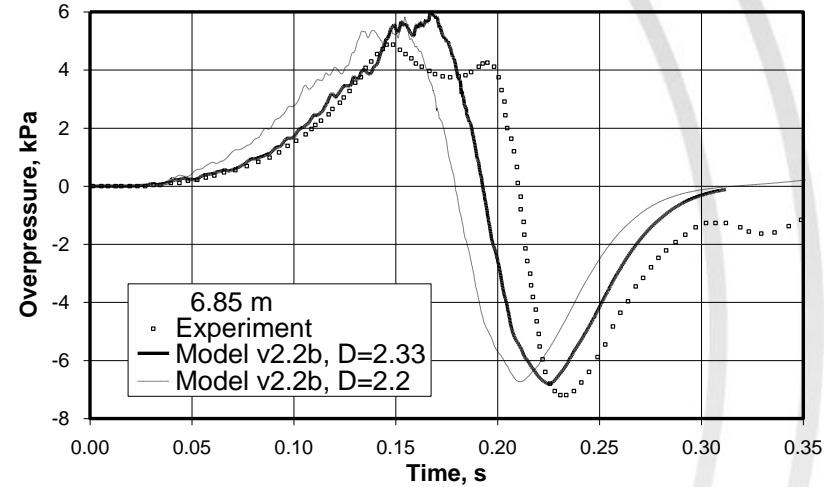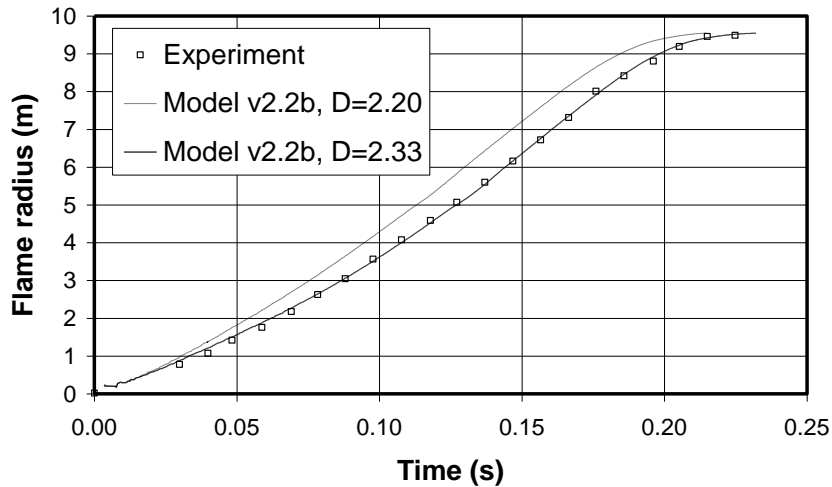


Lean and non-uniform hydrogen-air deflagrations

Calculation domain

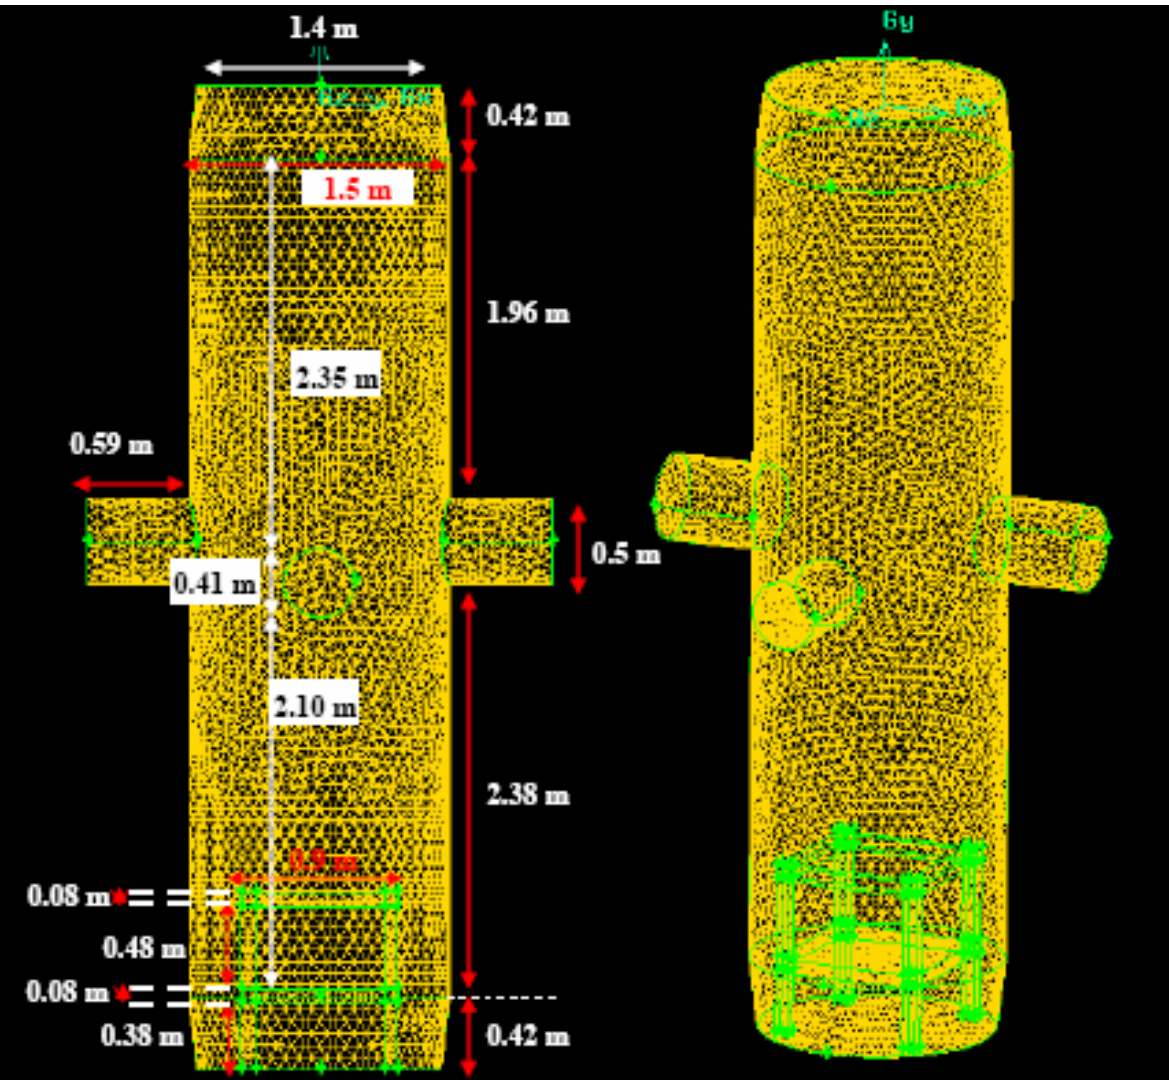


5.7 m height cylinder

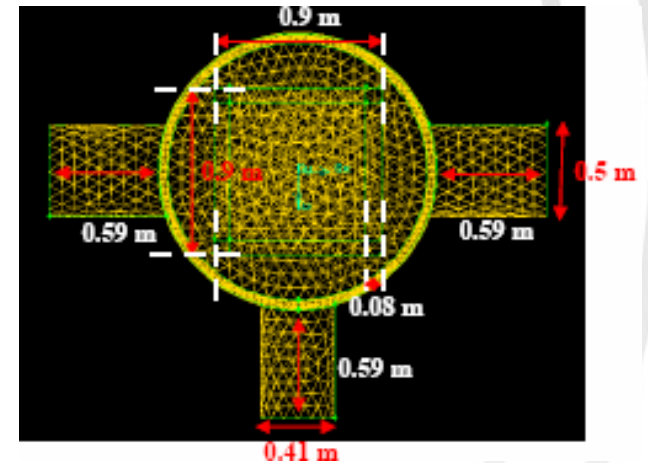


$\Delta_{CV} = 0.08$ m;
157,352 CVs in total;

Experiment: Whitehouse et al., Nuclear Engineering and Design, 1996, Vol.166, pp.453-462

Uniform mixture 12.8 vol. %

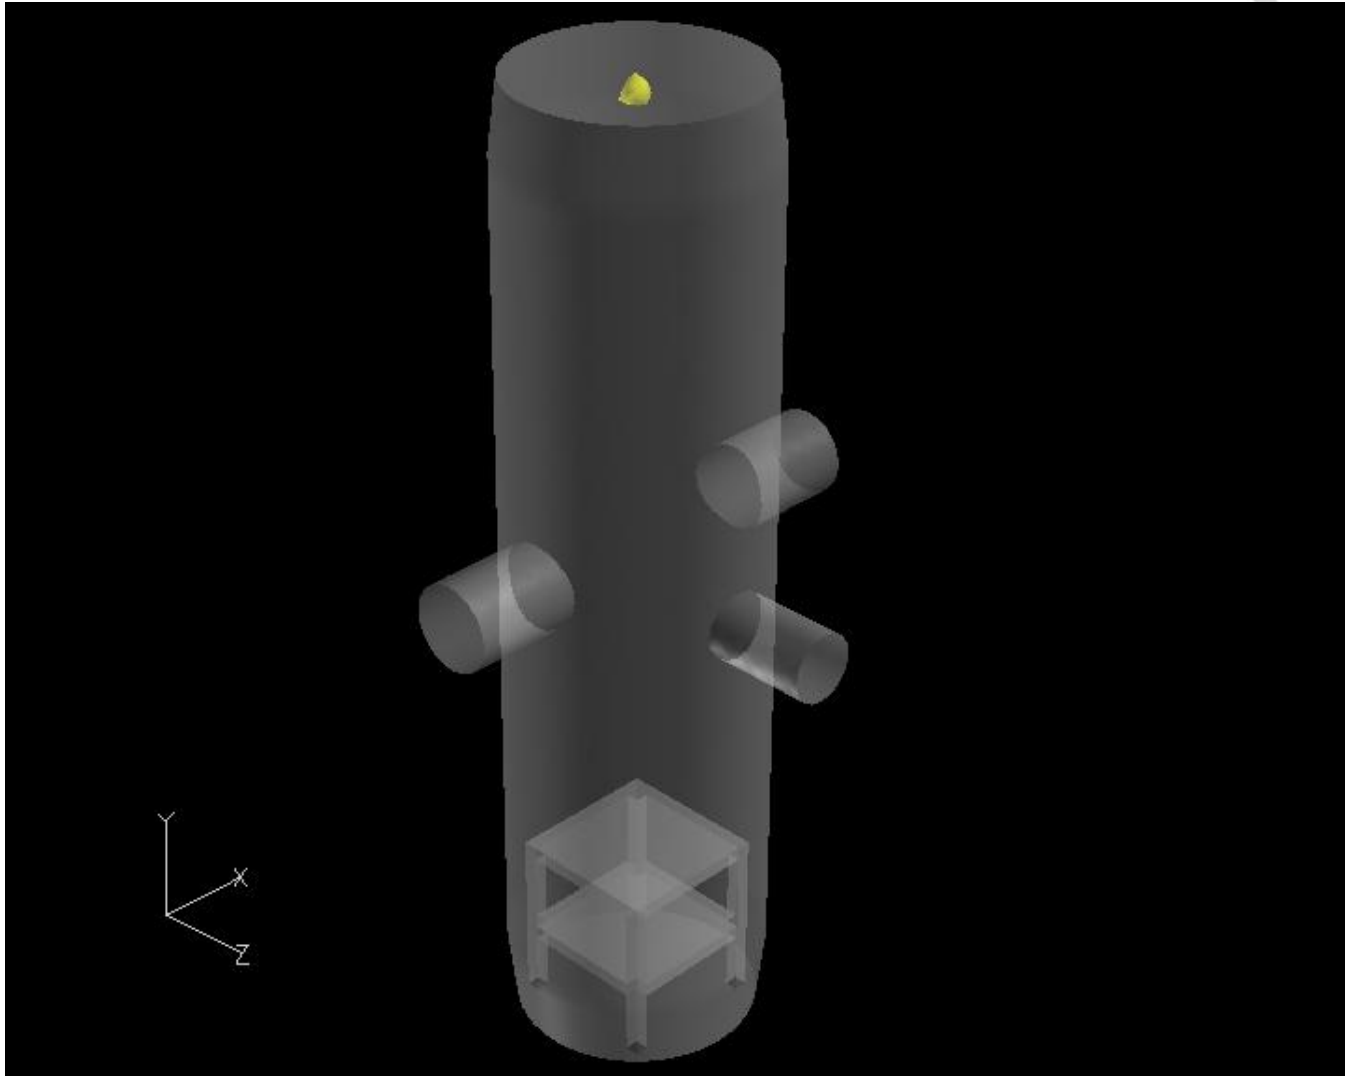


Effect of preferential diffusion

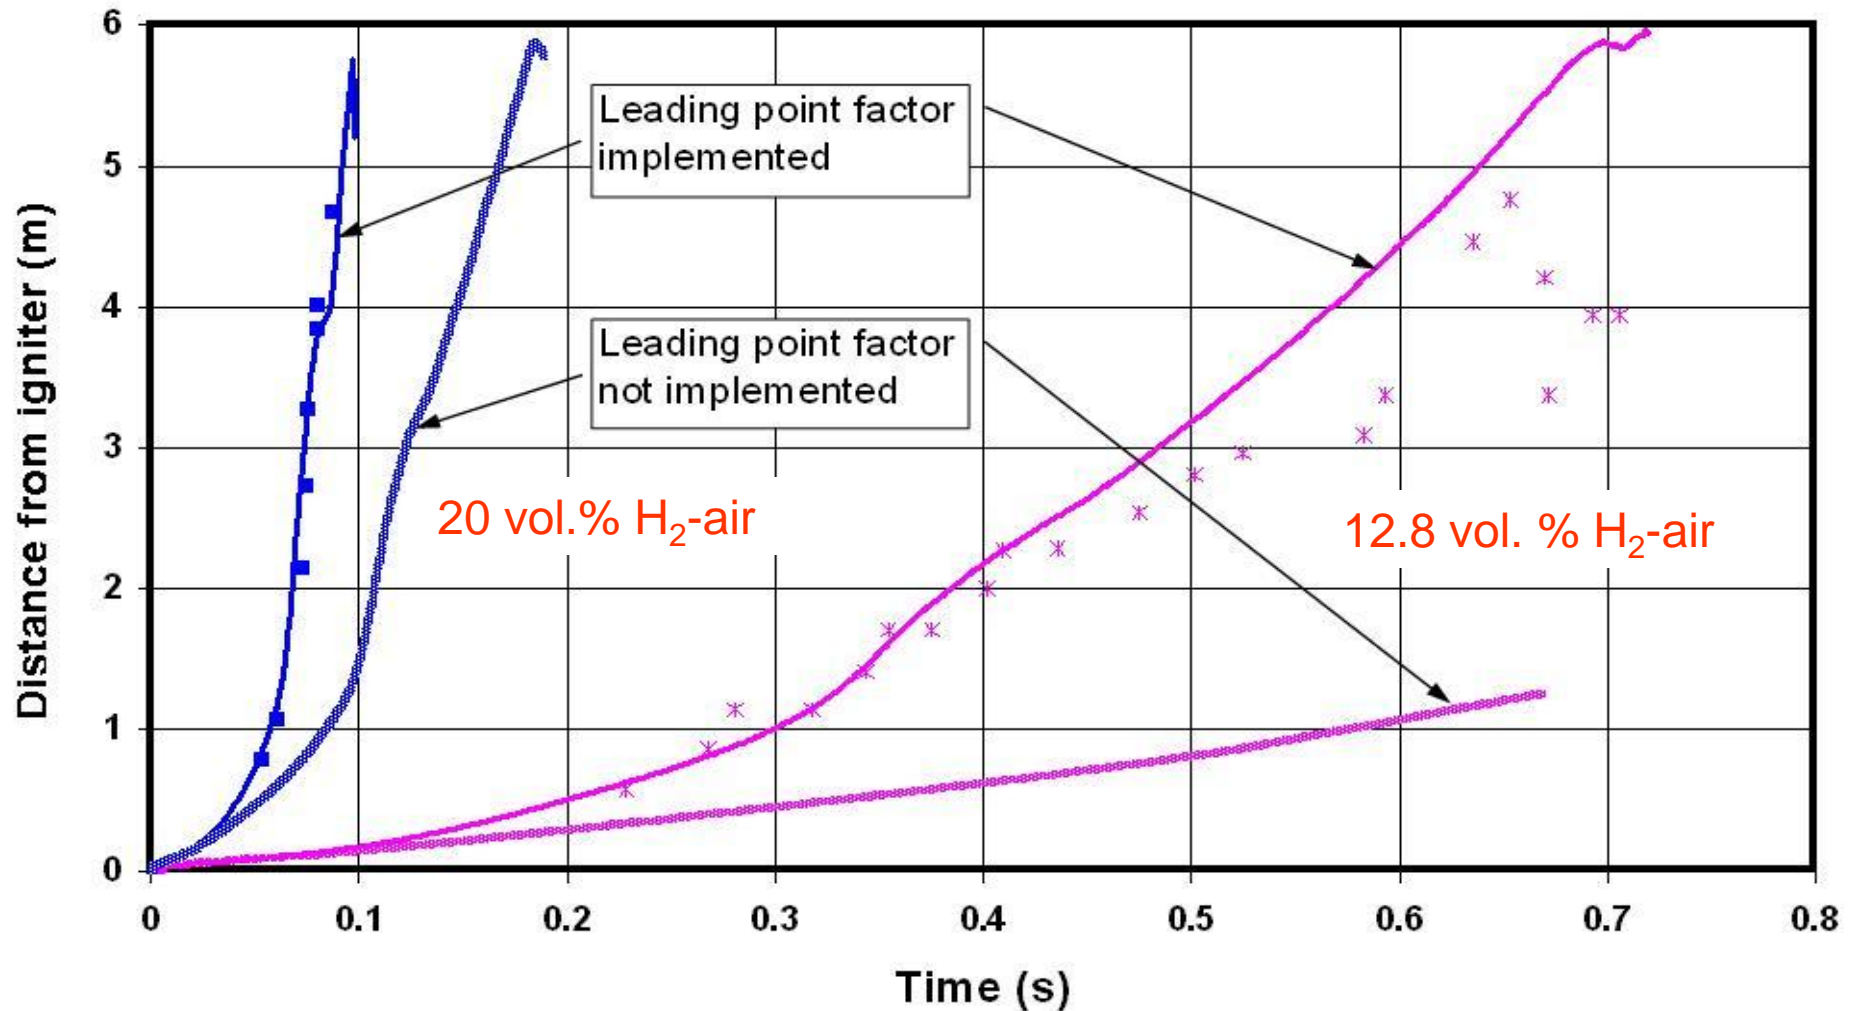

Closed vessel deflagration (1/2)



Whitehouse et al. (1996):

$L=5.7$ m; $D=1.5$ m ($V=10.1$ m³), uniform 12–20 vol. %

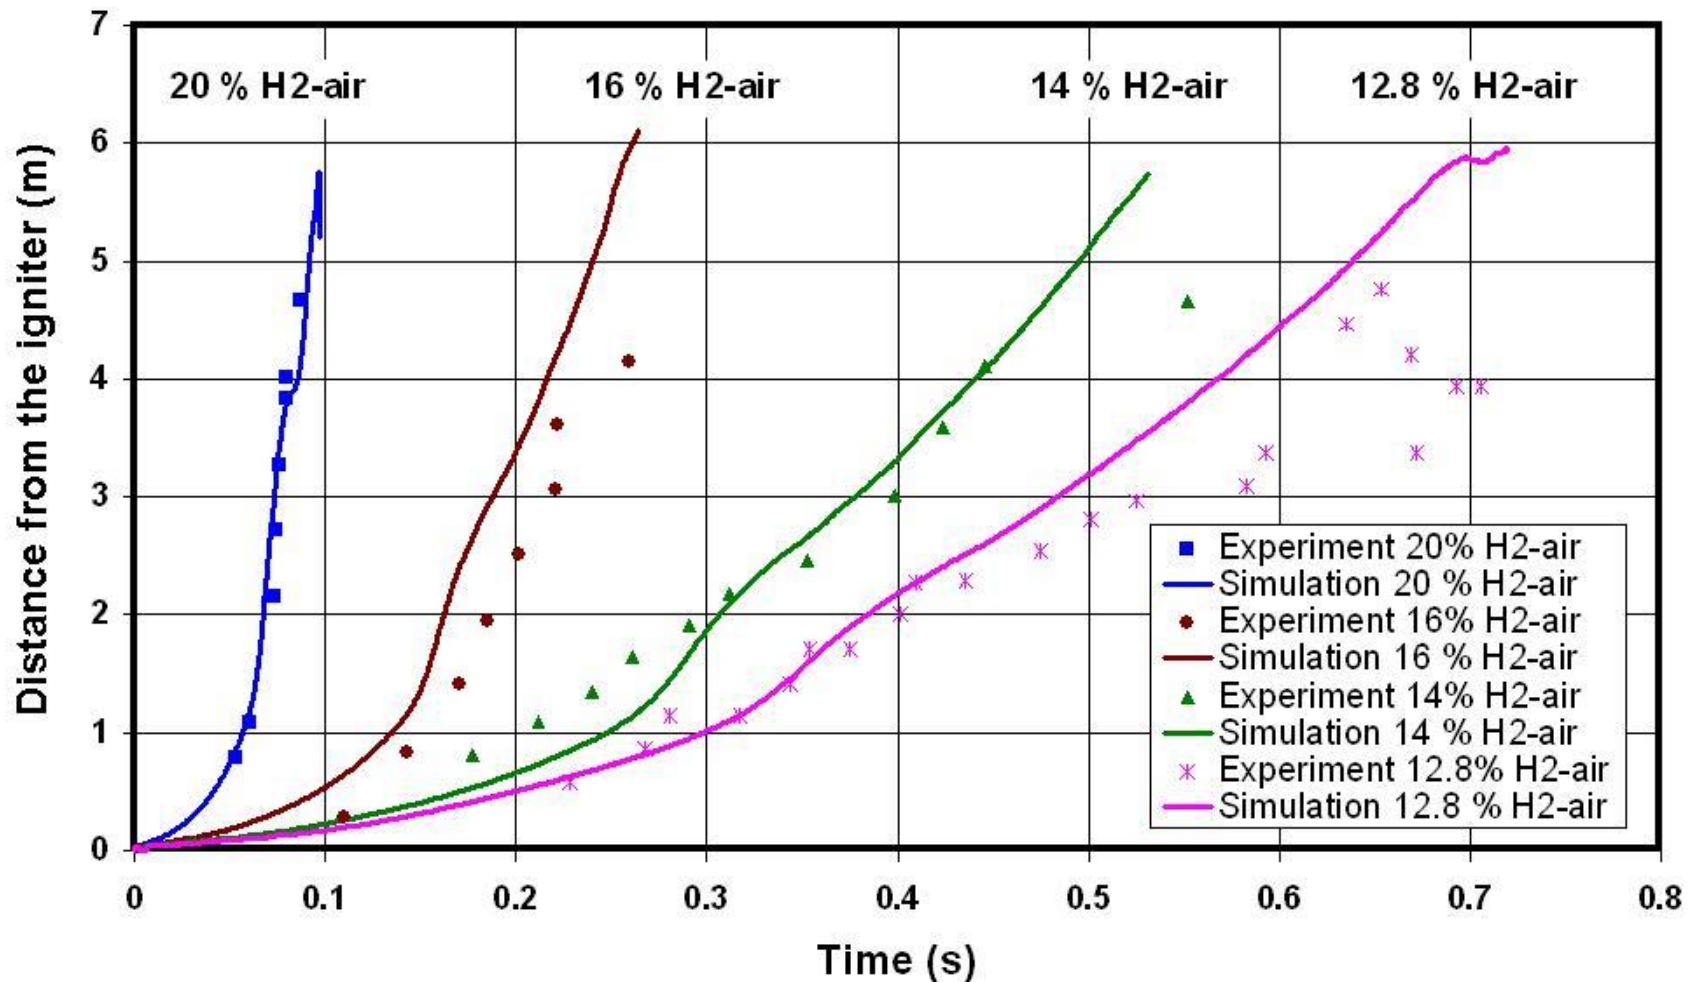


Effect of mixture non-uniformity on deflagration dynamics

Closed vessel: Whitehouse et al., 1996): $L=5.7$ m; $D=1.5$ m ($V=10.1$ m³),
uniform (12.8 vol. %) vs. non-uniform (average 12.6%, 2.5-27%)

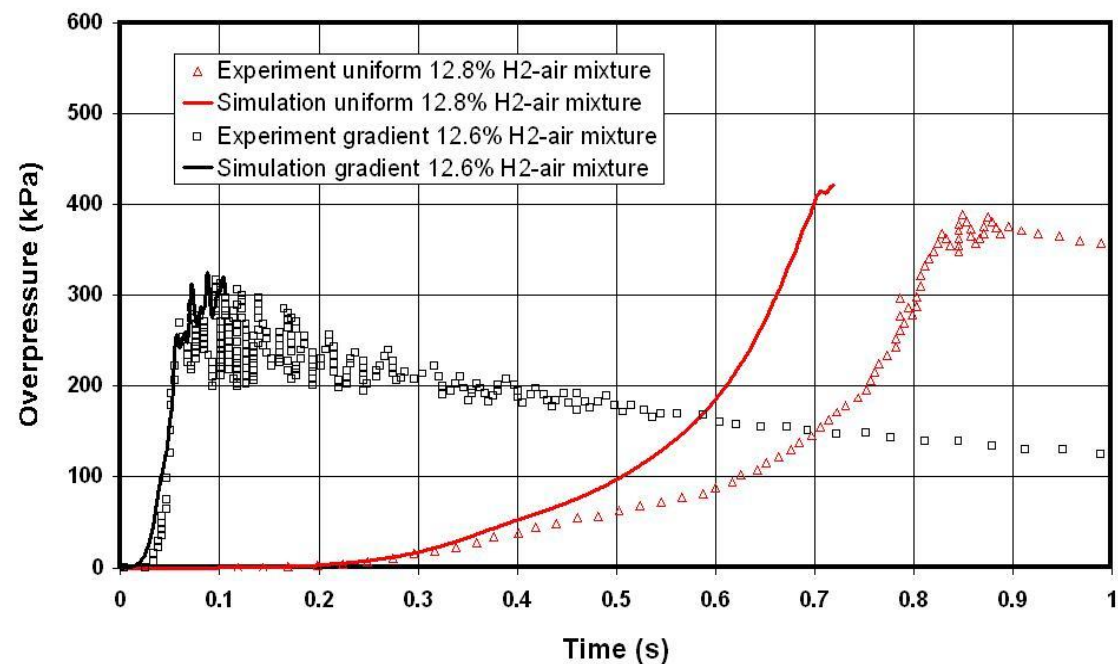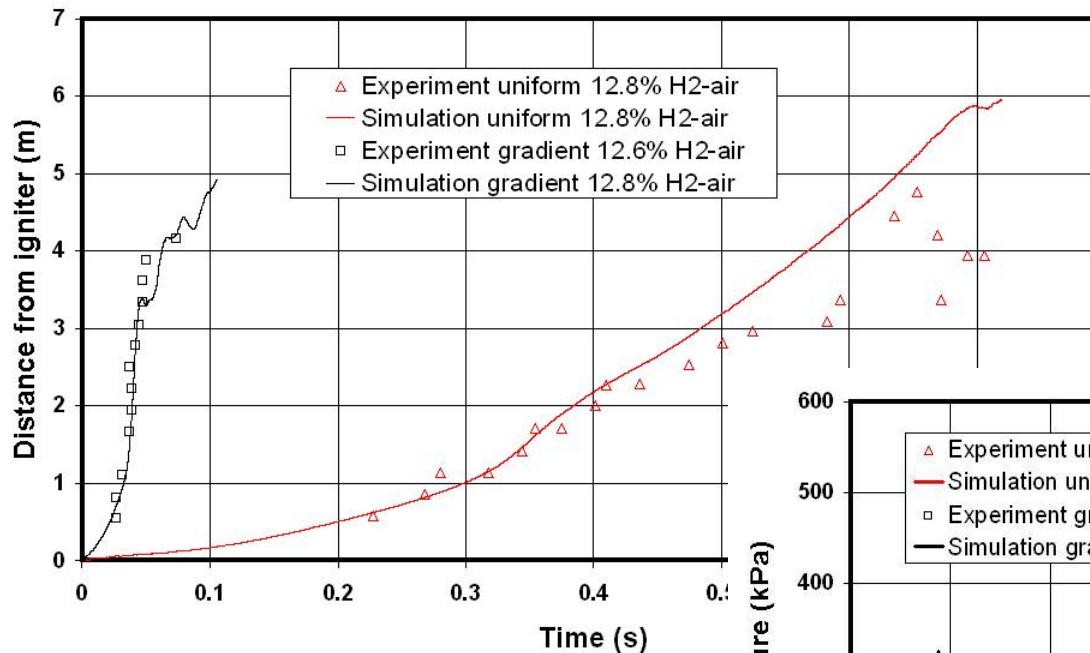


Hydrogen-air deflagrations in a tunnel (1/6)


- **SRI Tunnel** (1/5 scale), Groethe et al. (2005): 78.5 m length
- Horse-shoe cross section: 3.74 m²
- Hydrogen-air mixture: 30 and 20% by volume
- Vehicle size: LxHxW = 0.94x0.362x0.343 m (BR = 0.05)
- Distance between vehicles: 0.940 m

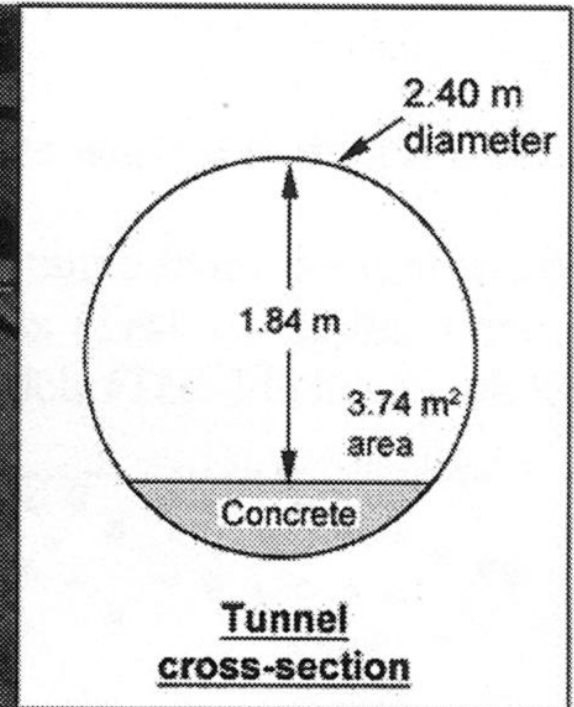


Hydrogen-air deflagrations in a tunnel (2/6)

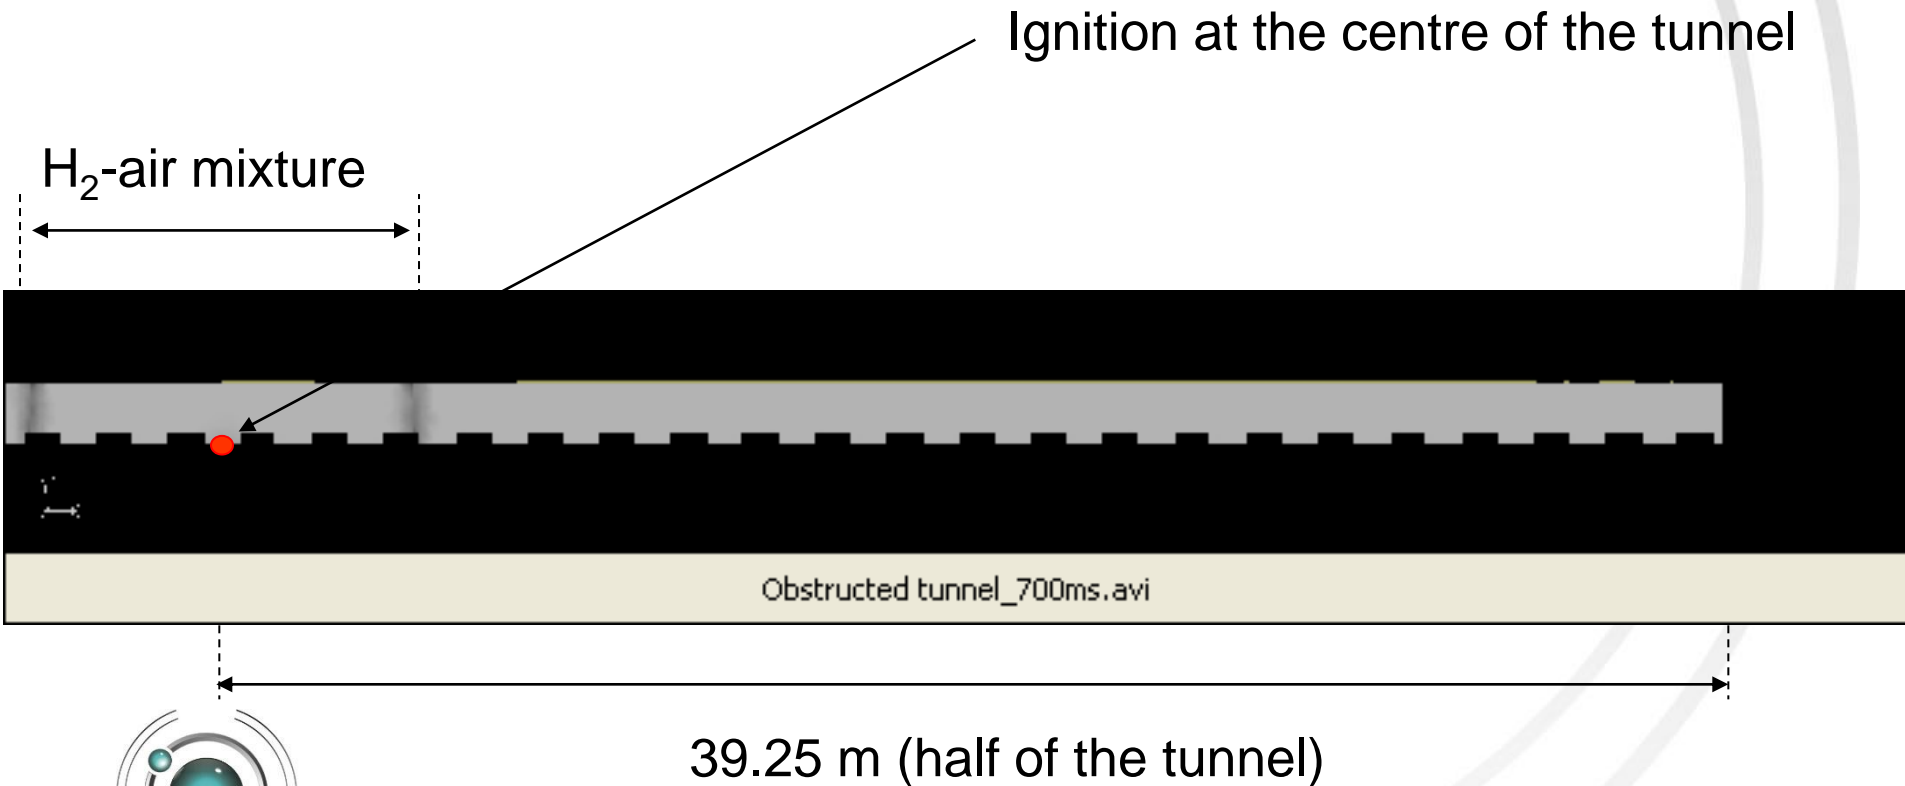

Hydrogen-air deflagrations in a tunnel (3/6)




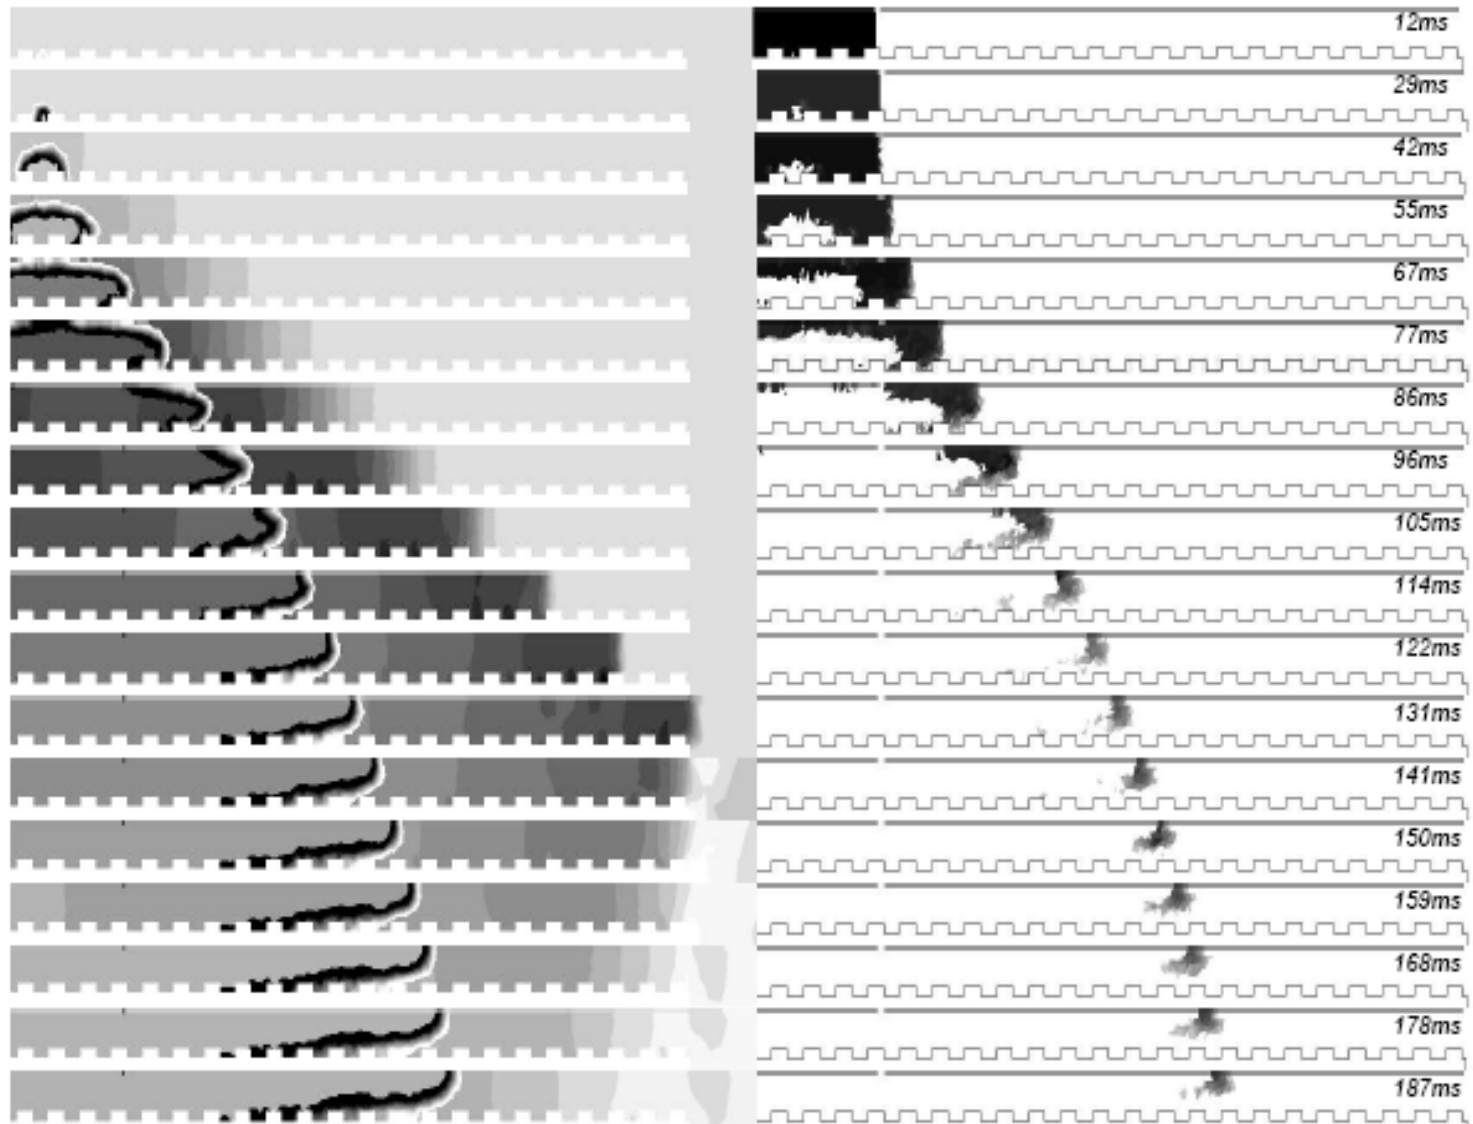


Hydrogen-air deflagrations in a tunnel (4/6)

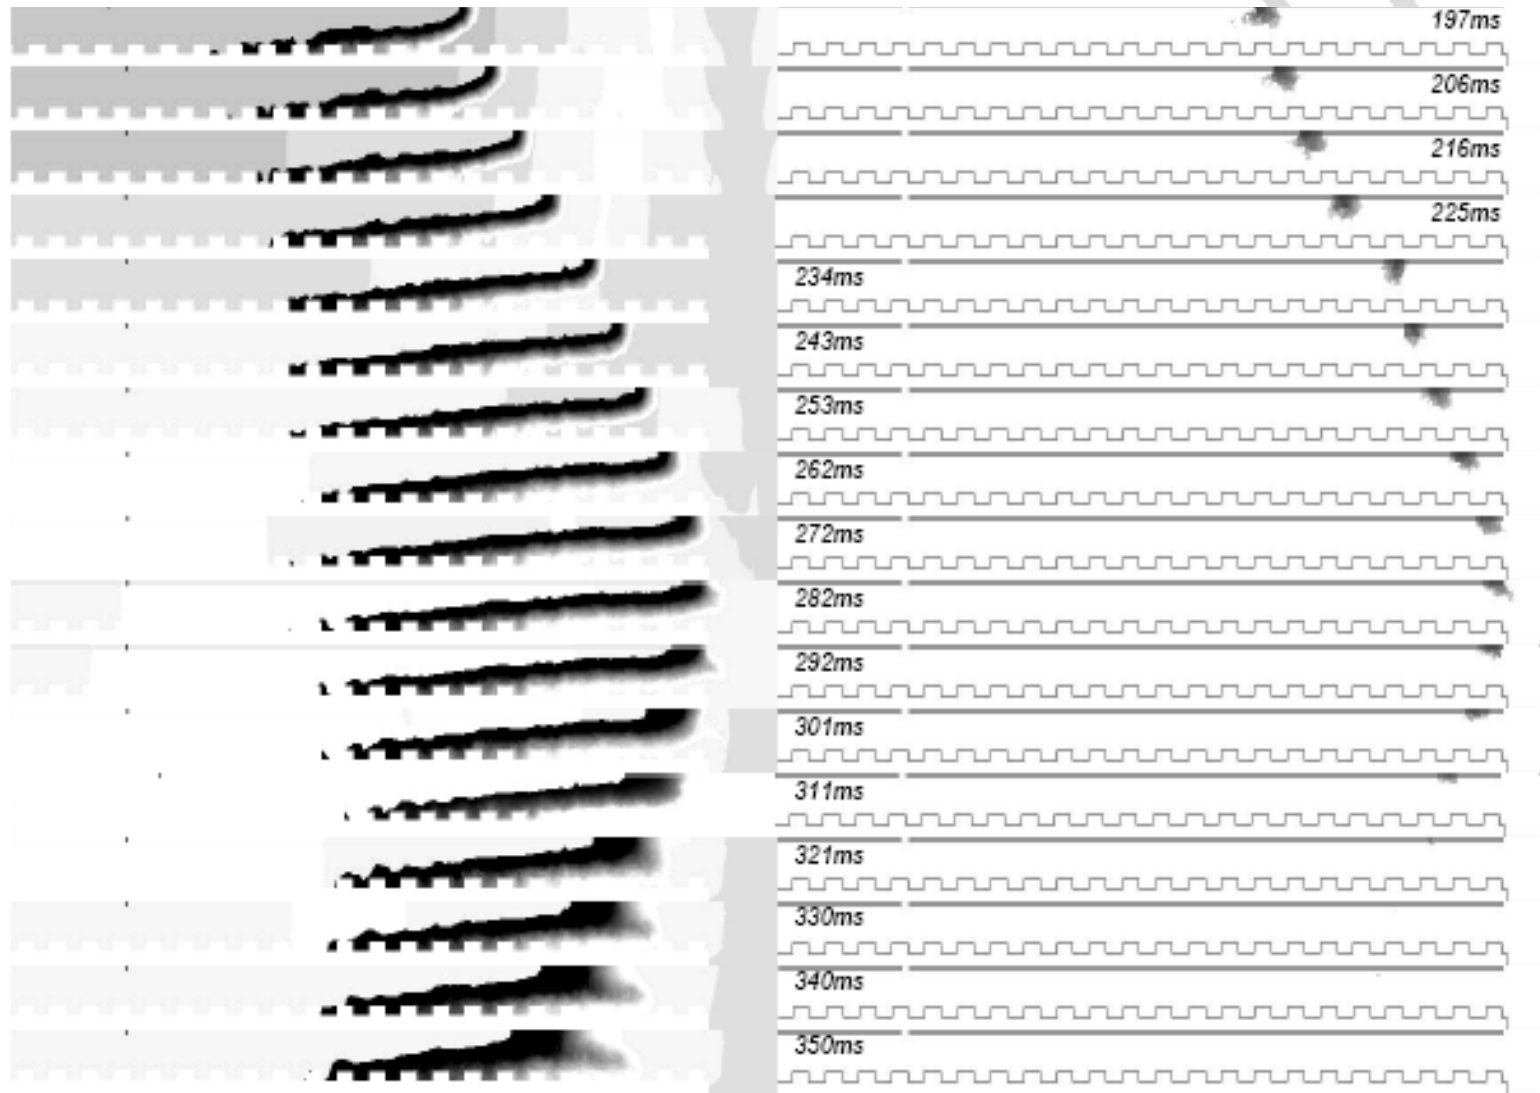





Hydrogen-air deflagrations in a tunnel (5/6)

Example: uniform **20 vol. %** hydrogen-air mixtures of 37.4 m^3 volume (10 m long cloud)

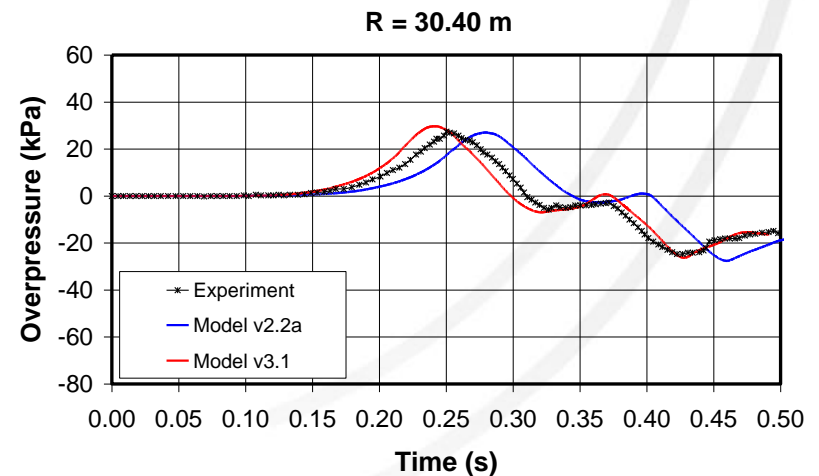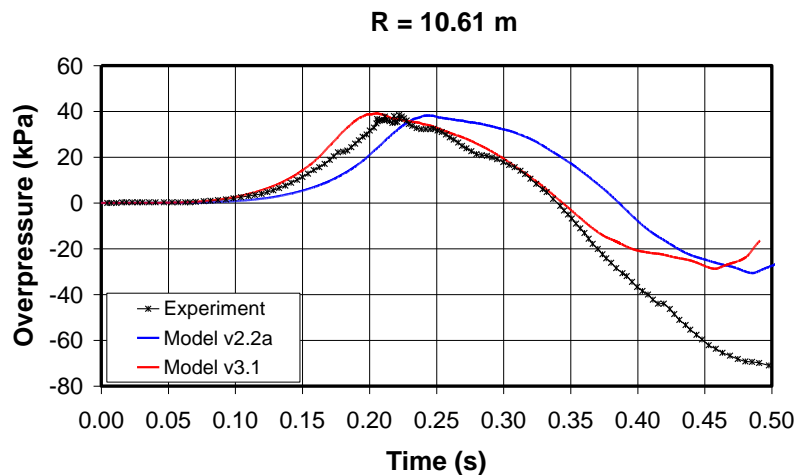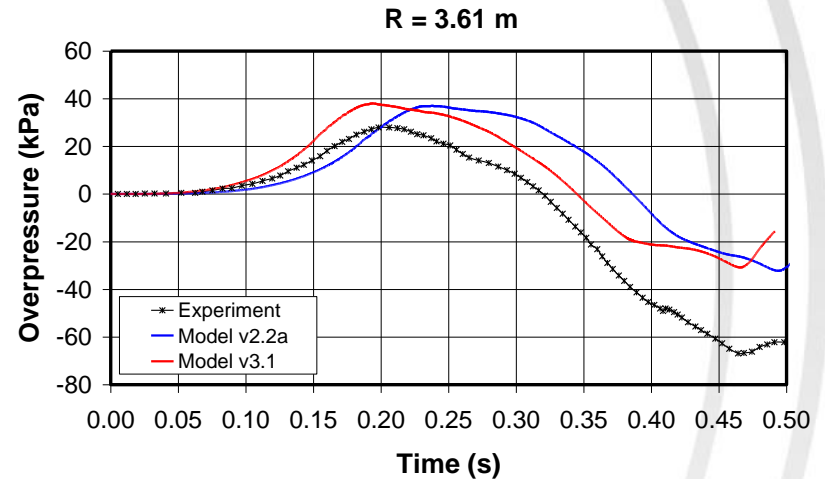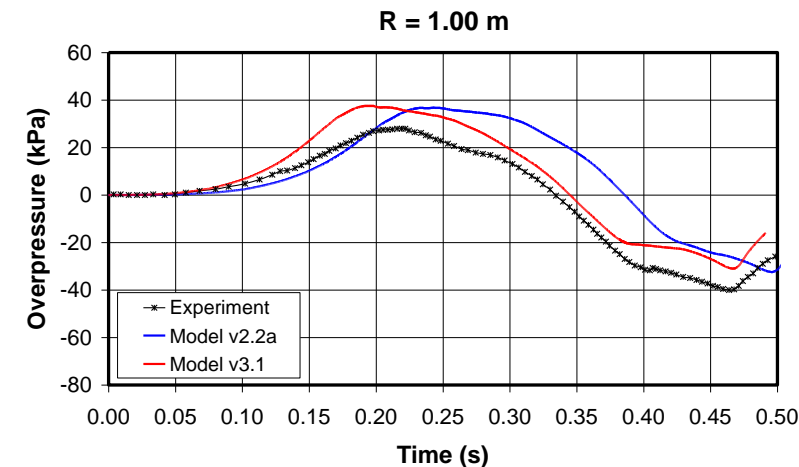


Hydrogen-air deflagrations in a tunnel (6/6)

30 vol. % hydrogen-air mixture deflagration, with obstacles

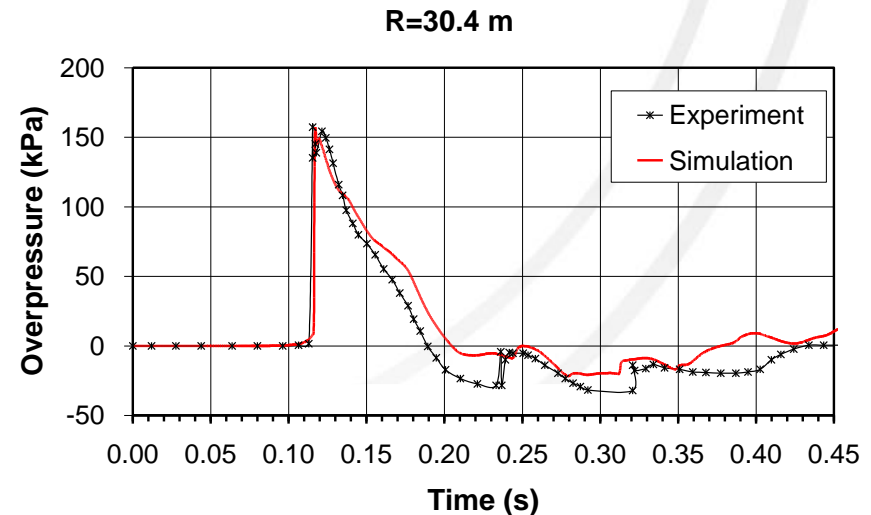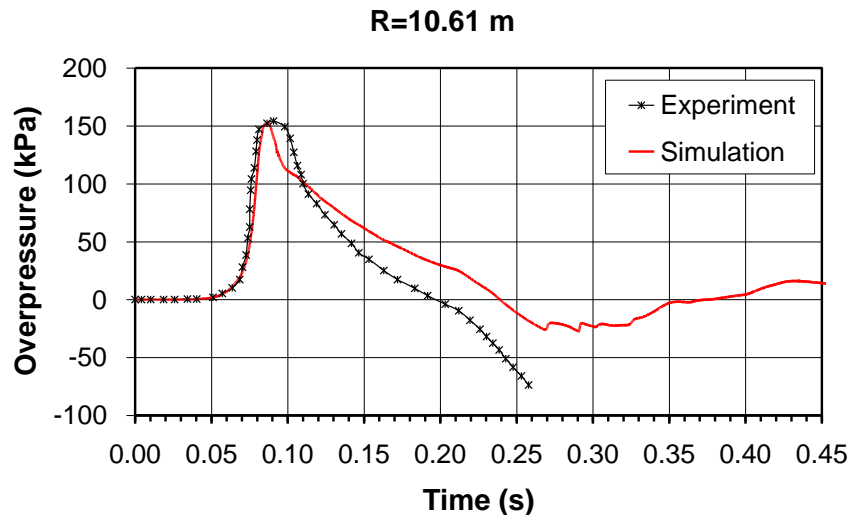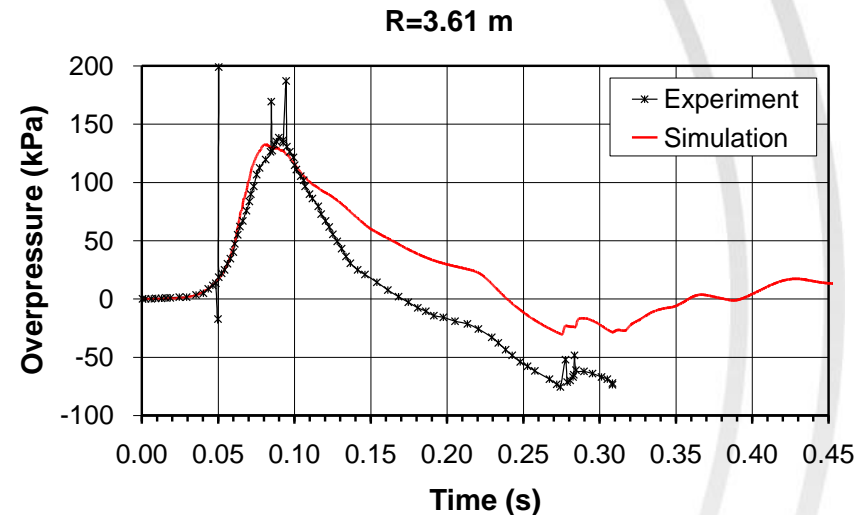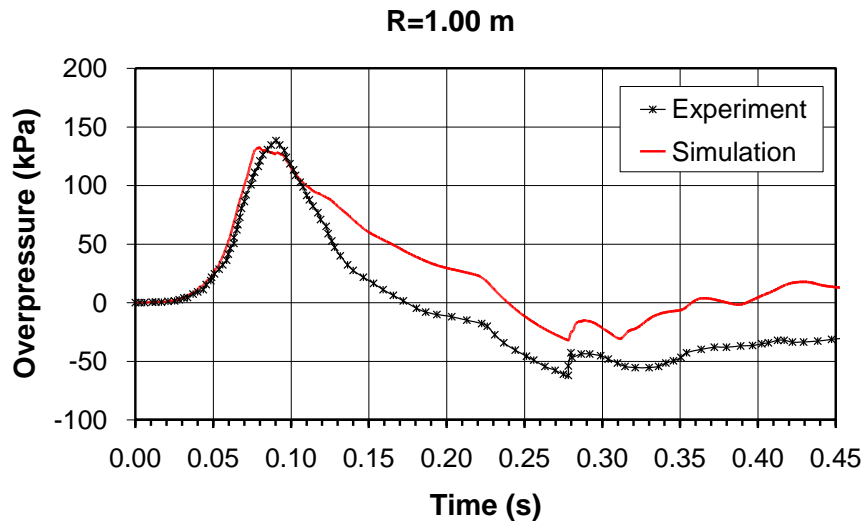


Deflagration venting

- ❖ Deflagration venting is the most widespread and cost-effective “explosion” mitigation technique.
- ❖ It reduces deflagration-incurred pressure to an acceptable level by venting gases out of an enclosure through a vent or number of vents of sufficient area during the deflagration. Design of explosion vents may be based on the vent sizing correlations or application of the computational fluid dynamics (CFD).

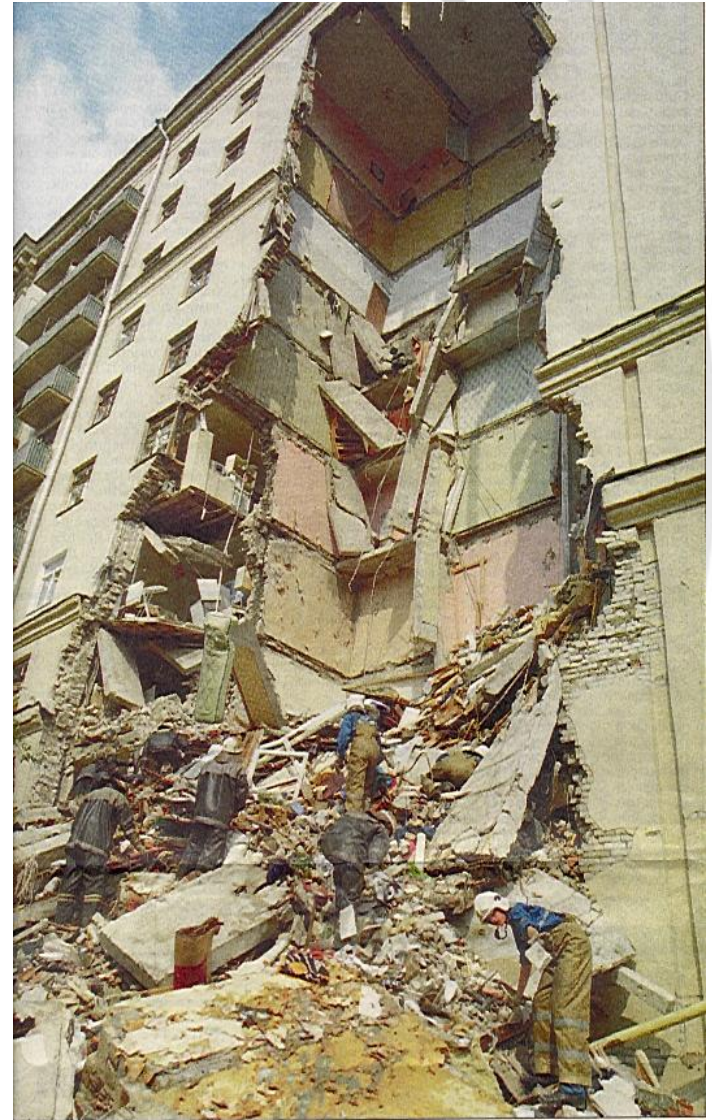

SOLVEX methane-air deflagration

● Puttock et al., 1996

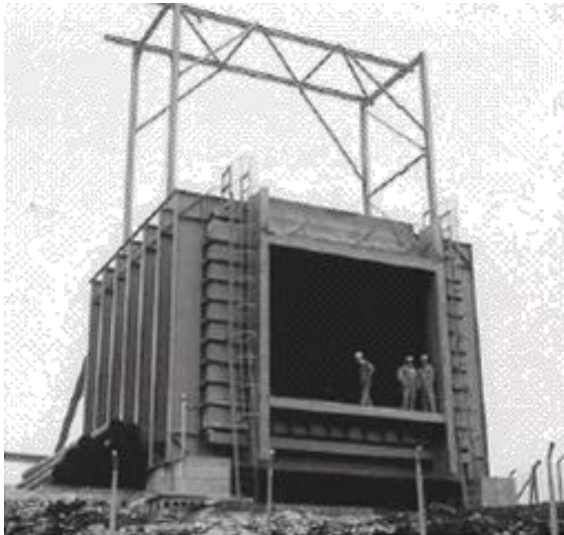

- ❖ The 547-m³ volume SOLVEX facility
 - Vessel size HxWxL=6.25x8.75x10.0 m
 - Vent size HxW=4.66x5.86 m in the centre of the wall
- ❖ 10.5% methane-air mixture
- ❖ Ignition at the centre of the rear wall
- ❖ Initially quiescent mixture, no special agitation of air in the surrounding atmosphere before ignition
- ❖ The repeatability of experiments was excellent

The nature of coherent deflagrations

- LES of SOLVEX


Shell 3



Shell 4




Ulster LES model

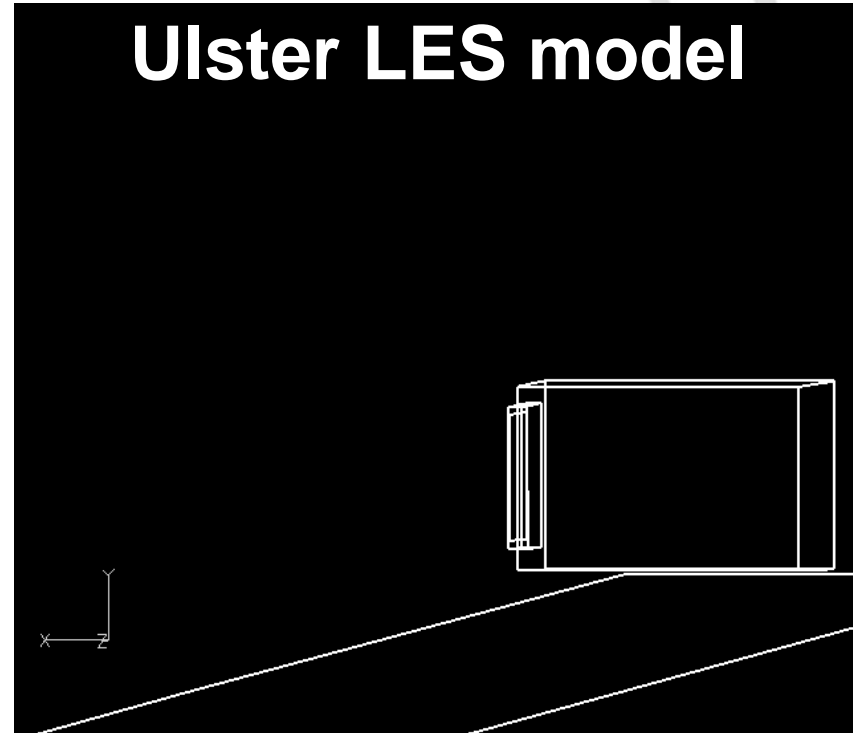

The nature of coherent deflagrations

- ❖ The **formation of the starting turbulent vortex** in the flammable mixture outside the enclosure is a **prerequisite** for an turbulent combustion intensification outside the enclosure.
- ❖ The **rapid** increase of the burning rate outside the enclosure commences after the flame front reaches the **edges** of the vent.
- ❖ The coherent steep pressure rise is observed both inside and outside the enclosure. The pressure rise in the atmosphere is a direct consequence of the highly turbulent deflagration outside the enclosure. At the same time there is **no** increase of the burning rate **inside** the enclosure.
- ❖ The pressure rise **inside** the enclosure is **caused** by the decrease of **mass flow rate** from the enclosure to the atmosphere due to the decrease of pressure drop at the vent as a result of intensive combustion of emerged flammable mixture in the atmosphere in front of the vent.



Vented deflagration (1/3)

Experiment:

Pasman H.J., et al (1974) Design of Pressure Relief Vents, pp.185-189.

Cylindrical vessel: $L \times D = 1.50 \times 0.97$ m, 0.95 m^3

Vents: 0.3 m^2 ($\varnothing = 0.62$ m) and 0.2 m^2 ($\varnothing = 0.50$ m)

Vent relief overpressure: 13.5 kPa ($\varnothing = 0.62$ m),
 7.5 kPa ($\varnothing = 0.5$ m)


$C_{H_2} = 29.6\%$ (vol.), central ignition,
quiescent mixture,
 $p_0 = 101.8 \text{ kPa}$, $T_{u0} = 281 \text{ K}$.

Simulations:

$S_{ui} = 1.73 \text{ m/s}$, $m_0 = 1.7$, $e = 0.57$

$\psi = 0.5$, $R^* = 1.2 \text{ m}$, $\Xi_K = 1.7$, $\Xi_{lp} = 1.28$


$\Delta x_{CV} \approx 0.045 \text{ m}$, total CV number 159,000

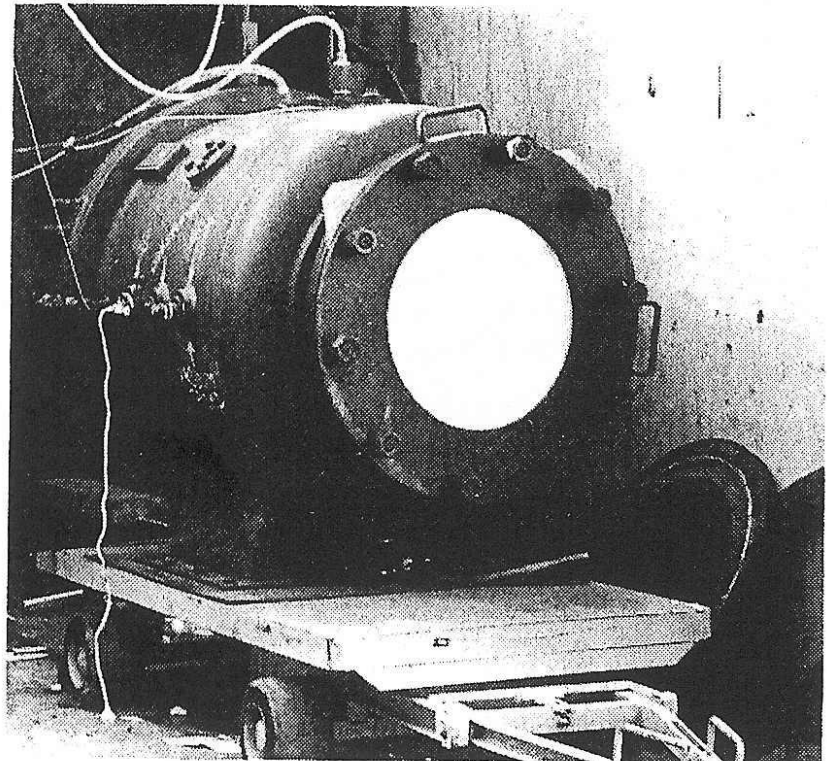


HyResponse

Vented deflagration (2/3)

Vent diameter 0.62 m

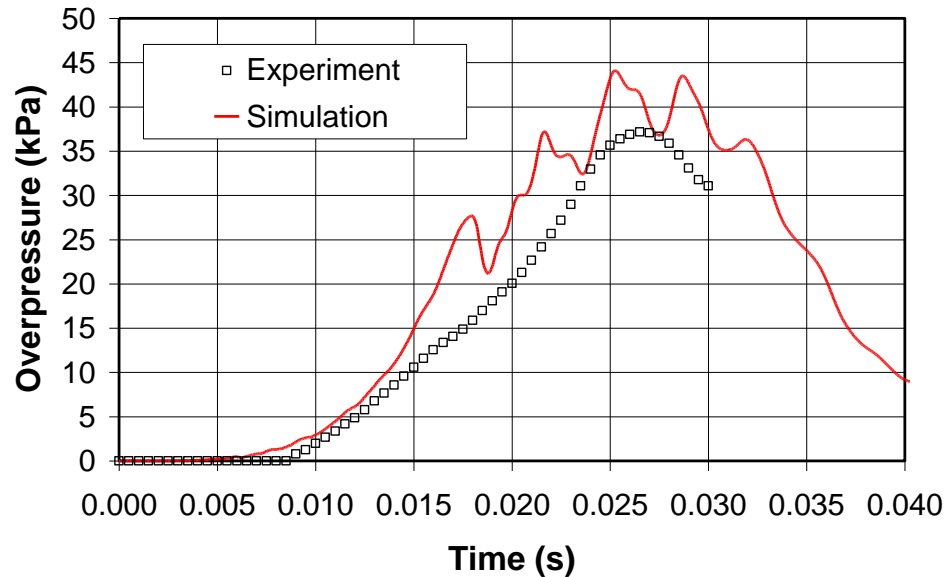


Vent diameter 0.50 m

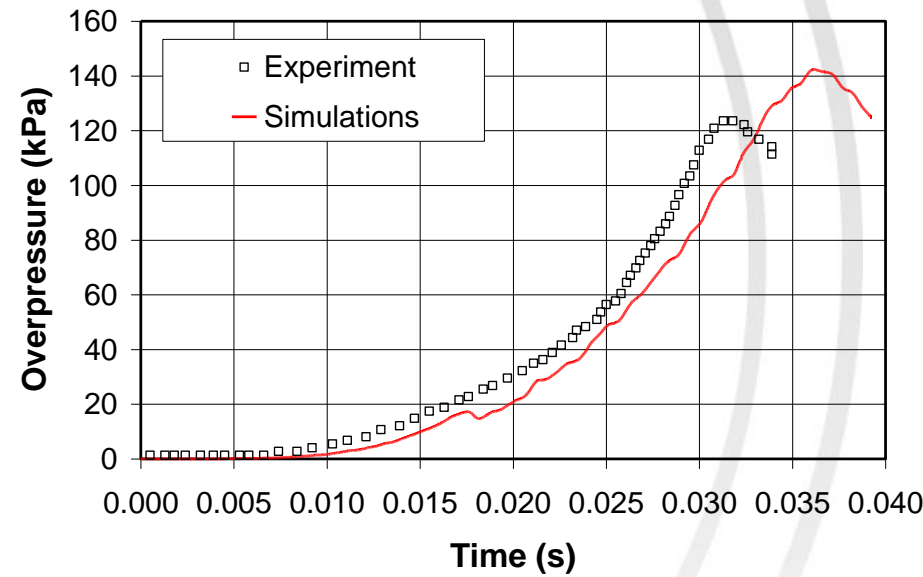

Vented deflagration (3/3)


Simulation, vent diameter 0.50 m

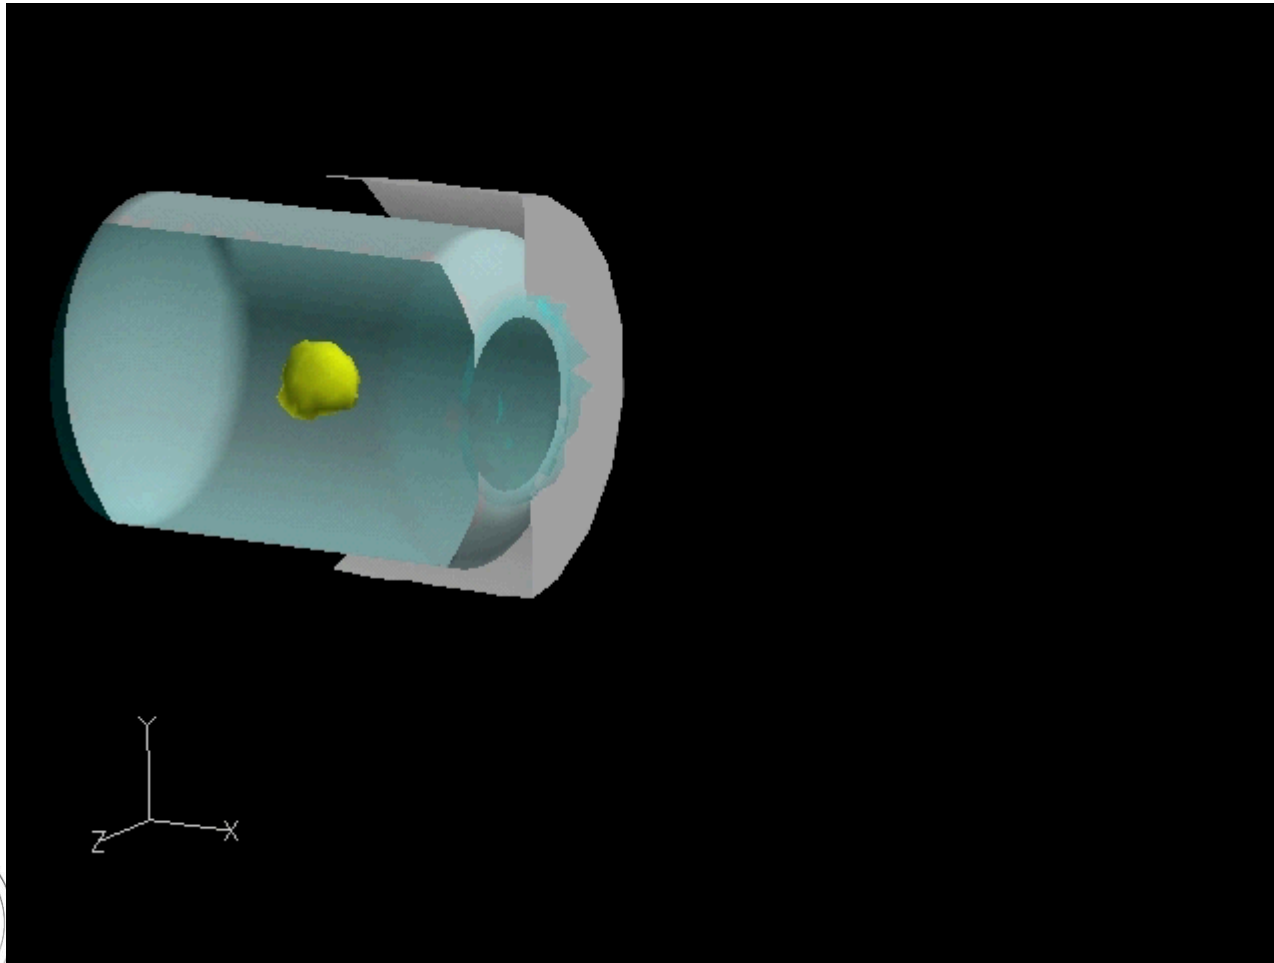

Localised hydrogen-air deflagration (1/3)

● Closed vessel deflagration

- **Limitation of hydrogen inventory** (stored hydrogen mass) is one of safety strategies for indoor use of hydrogen.
- Upper limit of hydrogen inventory may be defined using 10 kPa overpressure as a criterion for minor damage (such as windows breakage, etc.).
- A model to find the hydrogen inventory limit for use in poorly ventilated enclosures was developed and validated against HyIndoor project (www.hyindoor.eu).

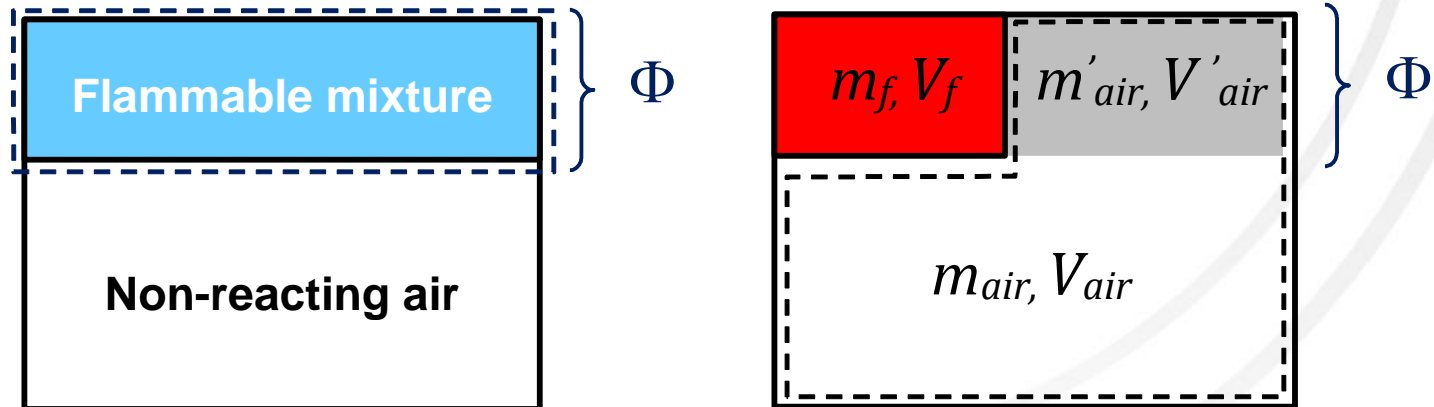

Localised hydrogen-air deflagration (2/3)

● Closed vessel deflagration

- The lowest hydrogen inventory, which provided 10 kPa overpressure, was obtained for H_2 vol. fraction in the mixture (LFL) $\varphi=0.04$ and vol. fraction of mixture in enclosure $\Phi=0.0786$, giving total H_2 vol. fraction in a sealed enclosure $\Phi \cdot \varphi = 3.14 \cdot 10^{-3}$ - smaller than LFL of 0.04! – or 0.261 g of hydrogen per 1 m³ of enclosure volume
- **Safety strategy example:** for 10,000 m³ warehouse allowable H_2 mass not to exceed 10 kPa overpressure is $m_{H_2}=2.62$ kg

Localised hydrogen–air deflagration (3/3)

● Vented deflagration

- Where inventory is larger than the specified limit $0.261 \text{ g H}_2/\text{m}^3$, the use of other mitigation techniques should be considered (natural/forced ventilation to exclude flammable mixture formation, deflagration venting, etc.).
- It is expected that venting of partial-volume or stratified mixture deflagrations should be easier than that of full-volume explosions due to lower amount of hydrogen.
- For the same amount of hydrogen deflagrations of non-uniform layered mixtures can generate overpressure above that for uniform mixture deflagration: maximum overpressure depends strongly on portion of mixture with largest burning velocity (i.e. largest hydrogen concentration in case of lean mixtures).
- Method to calculate the vent area to avoid destructive overpressure in case of localized mixture deflagration was described and validated within HyIndoor project too (Guidelines, www.hyindoor.eu).

Deflagration-to-Detonation Transition (DDT)

- Hydrogen is prone to the deflagration-to-detonation transition (DDT). DDT can happen in different environments, including tubes, enclosures, etc.
- The experimentally observed run-up distance for transition from deflagration-to-detonation (DDT) in stoichiometric hydrogen-air mixture in a tube has typical length to diameter ratio of approximately 100.
- The presence of obstacles in a tube increases a flame front area and reduces run-up distance for DDT.
- The DDT phenomenon is still one of the challenging subjects for combustion research.
- The initiation of detonation during DDT is thought to happen in a so-called hot spot(s), which potentially could be located within the turbulent flame brush or ahead of it, e.g. in a focus of a strong shock reflection


DDT in hydrogen-air mixtures

- ❖ DDT was observed in a large-scale test carried out by Pfortner and Schneider (1984) in Fraunhofer ICT (see **video next slide**). The experimental set up included a “lane” (2 parallel walls 3 m apart with height 3 m and length 12 m) and an enclosure (driver section) of sizes $L \times W \times H = 3.0 \times 1.5 \times 1.5$ m (6.75 m³ volume) with an initially open to the “lane” vent of 0.82x0.82 m.
- ❖ The “lane” and the enclosure were filled with the mixture kept under a plastic film. Venting of hydrogen-air deflagration (initiated at the rear wall of the enclosure by five ignitors) into the partially confined space simulating a “lane” resulted in DDT.
- ❖ DDT occurred 54.61 ms after ignition in the “lane” when the accelerated flame from the driver touched the ground.


DDT in a “lane”

- Fh-ICT experiment IA4 (1984)


- 22% hydrogen-air mixture
- 3.0x1.5x1.5 m “driver” section
- 12.0x3.0x3.0 m “lane”

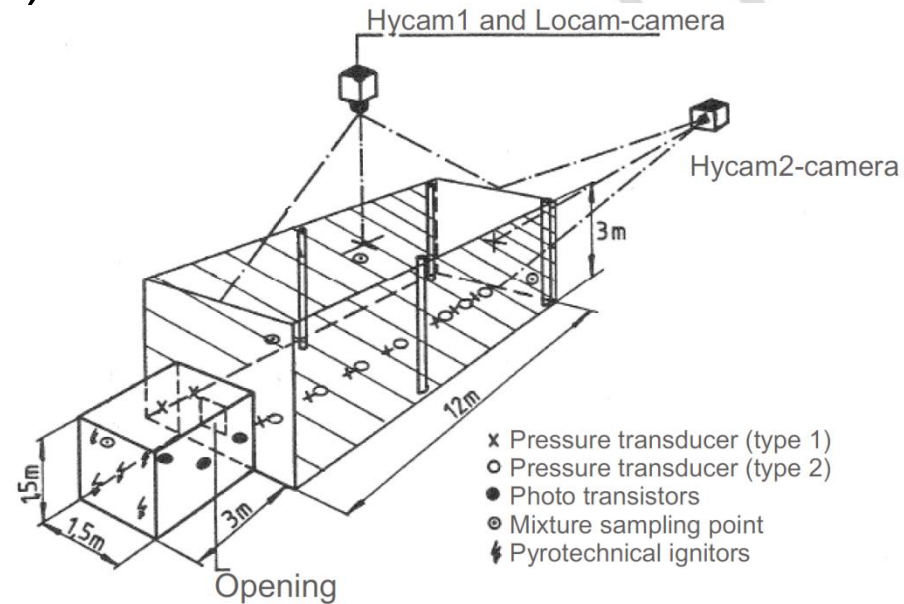

DDT in hot spots

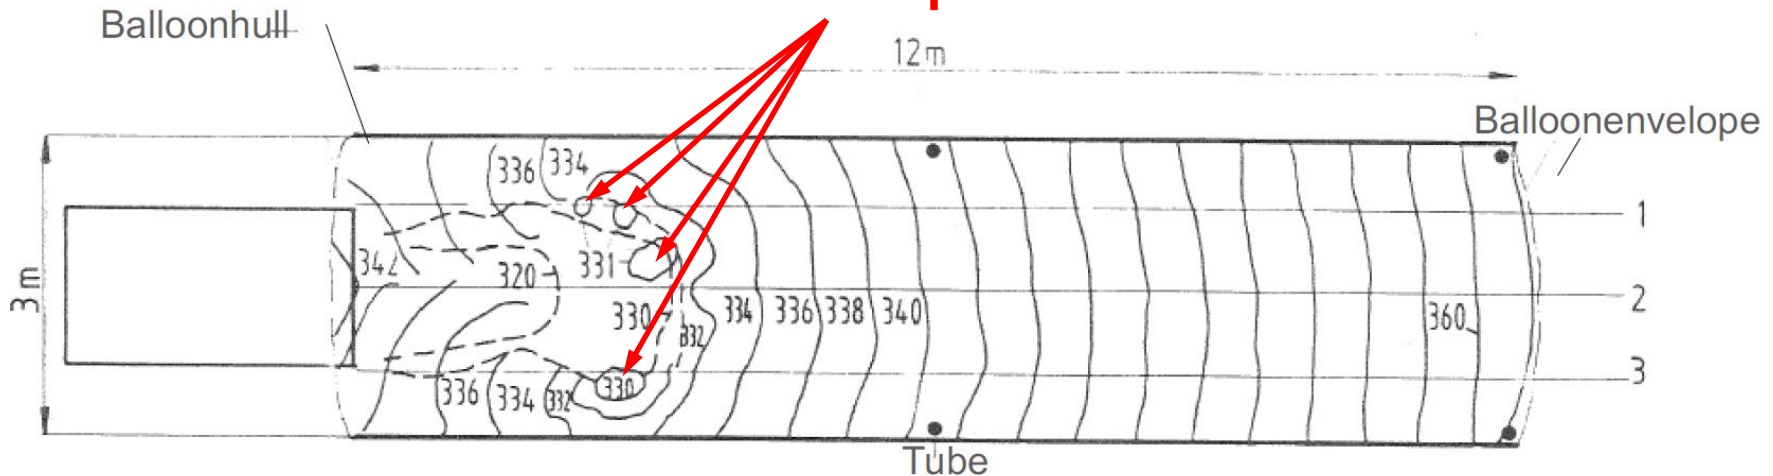

Video of DDT in a “lane”

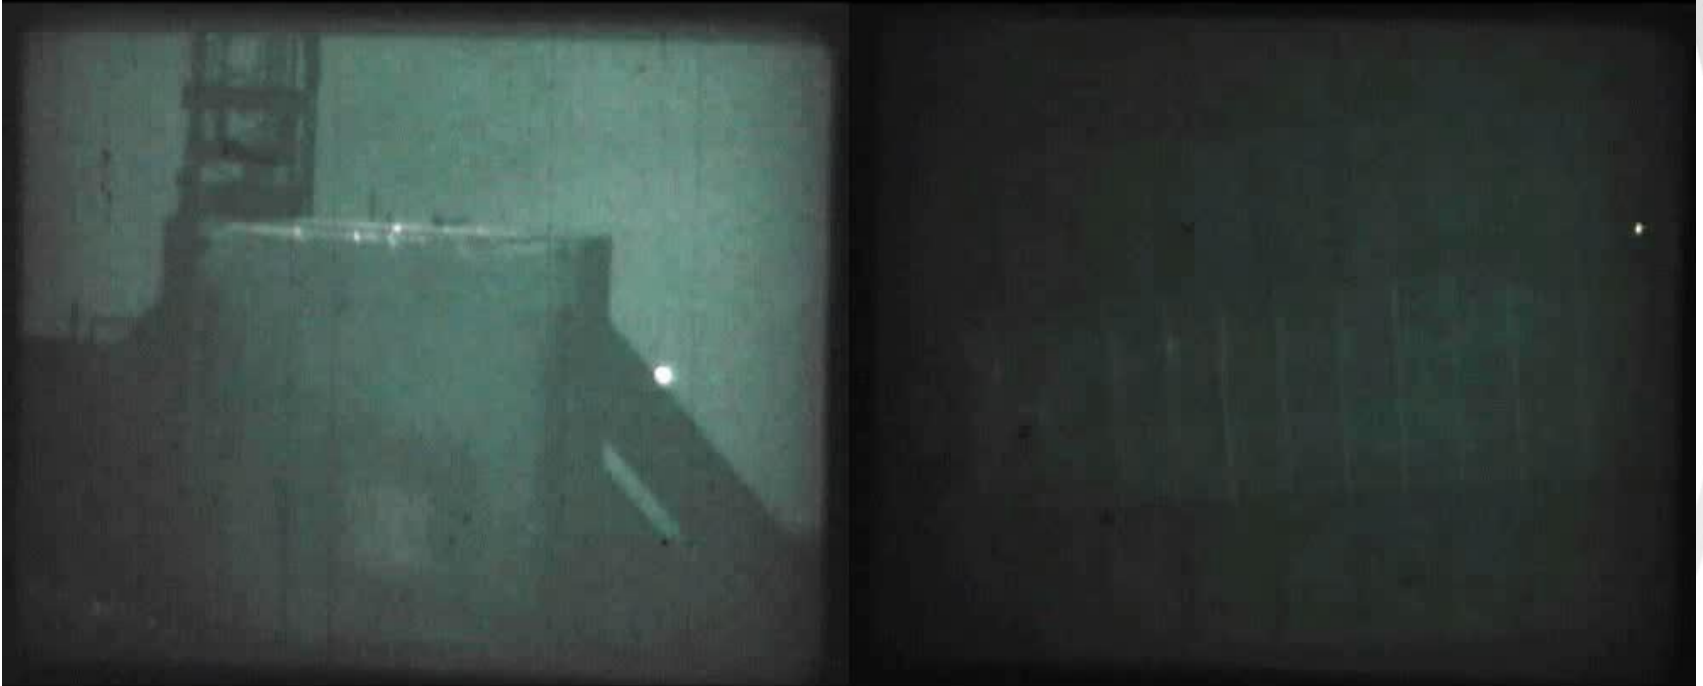


Deflagration-to-Detonation Transition (DDT)

- Deflagration can transit to detonation after a flame travelled some time and some distance.
- Flame speed exceeds the speed of sound at the onset of DDT.
- Generates a large pressure spike at DDT somewhere in the region of 3.0 MPa.
- DDT can occur in:
 - Highly-confined regions
 - Highly-congested regions
- Different physical mechanism involved for a high speed flame.
- DDT is not a continuous process but rather a step-wise change.



The run-up distance to DDT (smooth tubes)

- The distance from the ignition point to the location of DDT, i.e. **run-up distance** X_D , decreases with the increase of pressure. At the initial pressure of **1 bar** it is about **70 cm** and at pressure of **5 bar** it is about **7 cm** (correlation for X_D is applicable to empty tubes with internal diameter more than 20 detonation cell sizes, $d > 20\lambda$).

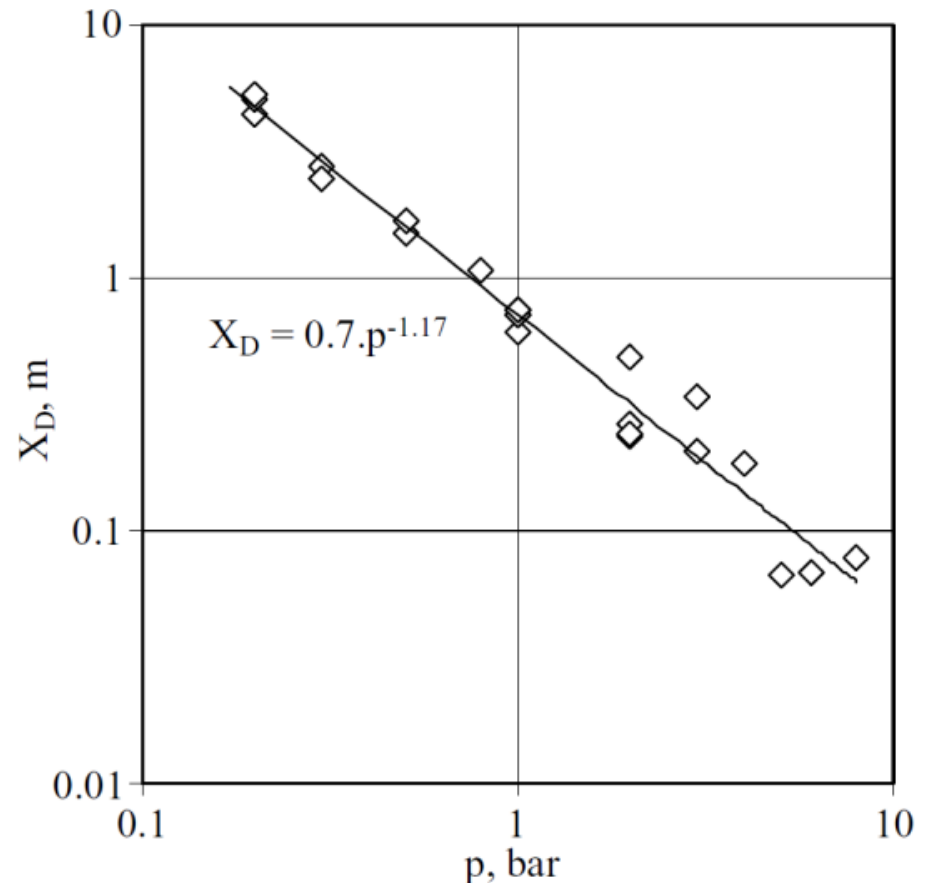


Detonability limits

- The upper and lower detonation limits (UDL and LDL) are the maximum and minimum concentrations of hydrogen in air or oxygen for stable detonations to occur.
- **The detonability range of hydrogen in air is 11-59 vol. % (Alcock et al., 2001), which is narrower and within the flammability (deflagrative combustion) range of 4-75 vol. %.**
- The detonability limits are not fundamental characteristics of the mixture as they strongly depend on the size of the experimental set-up where they are measured. Indeed, a diameter of the tube, where detonation can propagate, should be of the order of a detonation cell size. However, the detonation cell size increases with approaching the detonability limits. Thus, the larger is the scale of an experimental apparatus the smaller is the LDL (and the larger is the UDL).





Detonation cell size

- The **detonation cell size**, λ , is a measure of reactivity of a fuel-oxidizer mixture. The wave front is not planar and composed of reaction cells (see next slide).
- A detonation wave has a complex 3D structure with a characteristic fish-scale pattern.
- Highly reactive mixtures such as acetylene-air or hydrogen-oxygen have very small cell sizes (about 1 mm).
- Cell lengths for stoichiometric hydrogen-air and hydrogen-oxygen mixtures at 101.3 kPa are 15.4 mm and 0.6 mm, respectively.

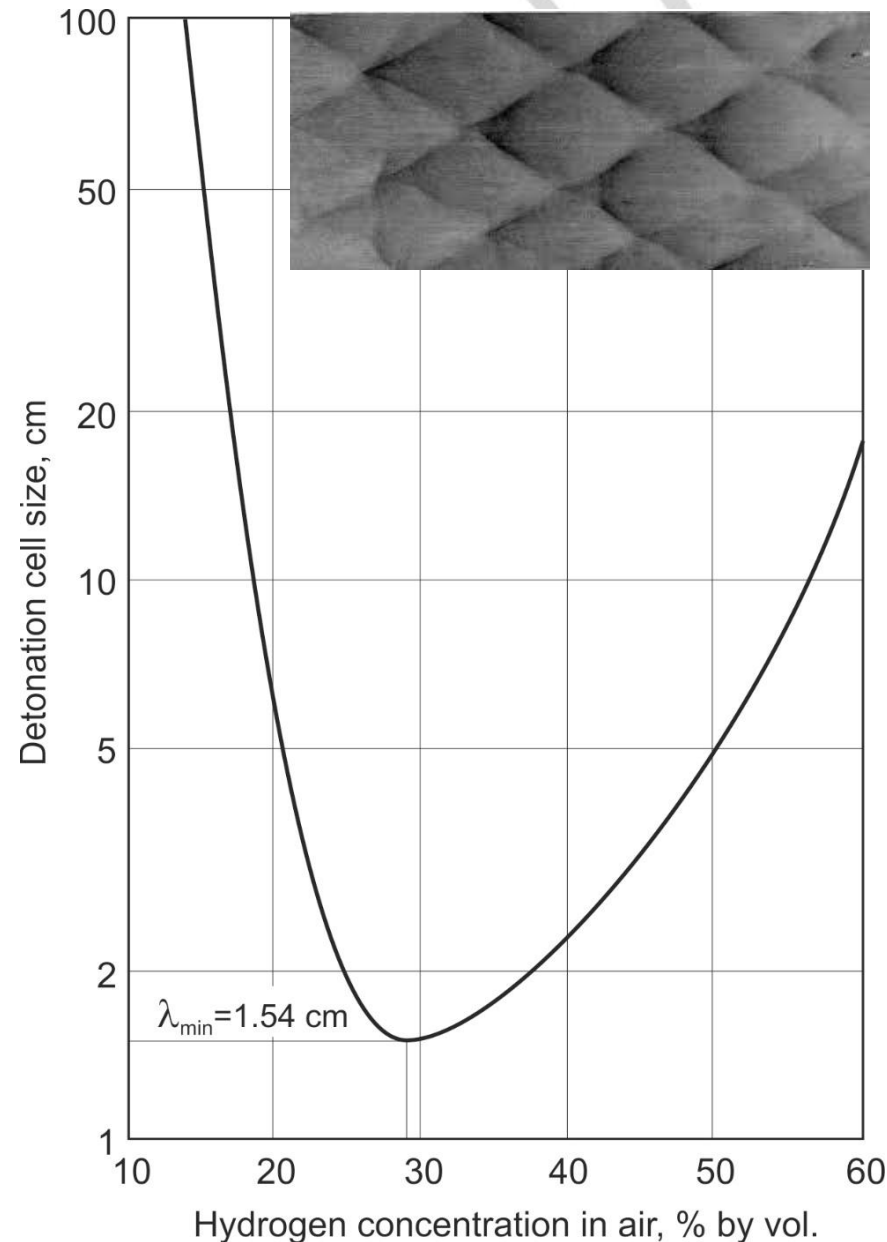

Structure of a detonation front

- 2D illustration of the detonation front structure is given below according to Zeldovich, von Neumann and Doring (ZND) model.
- Cell size decreases with pressure increase for hydrogen-air mixtures.
- The cell width of hydrogen-air detonations increases significantly with the concentration of diluents (carbon dioxide or water).

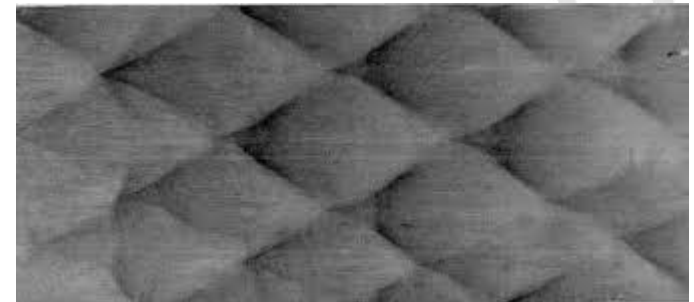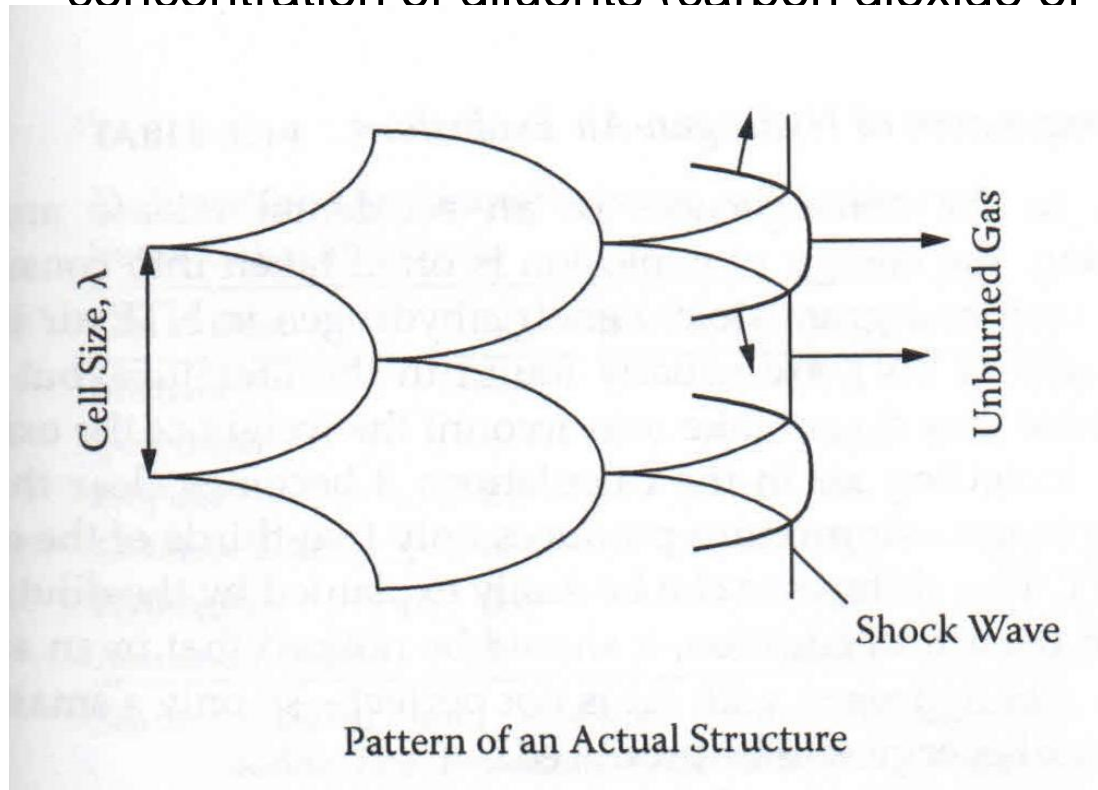

Critical tube diameter for detonation onset

Detonation may only occur if the size of a duct or mixture volume is sufficiently higher compared to λ (if supersonic flow regime is developed)

- $D > \lambda/\pi$, where D is a smooth tube internal diameter
- $d > \lambda$, where d is the transverse dimension of the unobstructed passage in a channel with obstacles
- $L > 7\lambda$, where L is a more general characteristic size defined for rooms or channels
- $D_{jet} > (14-24)\lambda$, where D_{jet} refers to the jet exit diameter
- **Congested area: with stoichiometric hydrogen-air mixture DDT observed in cloud containing 4 g of hydrogen**


Factors affecting the detonability range

- Detonability range for **hydrogen-air mixtures**: 11-58.9 vol. % (Alcock et al, 2001)
- Effect of the **size of the experimental rig**: LDL varies between 13.5 and 19.0 vol. % and UDL – between 61 and 70 vol. %.
- **Effect of temperature**: and increase of T from 293 to 373 K leads to a **widening of detonability range**. LDL is reduced from 11.6 to 9.4 vol. %; UDL – increased from 74 to 76.9 vol.% for hydrogen-air mixtures.



Effect of diluents on detonability limits (1/3)


- Effect of CO_2 addition on detonability range of hydrogen-air mixtures.
- Carbon dioxide significantly changes detonability range: it is marginally reduced in the presence of this diluent.

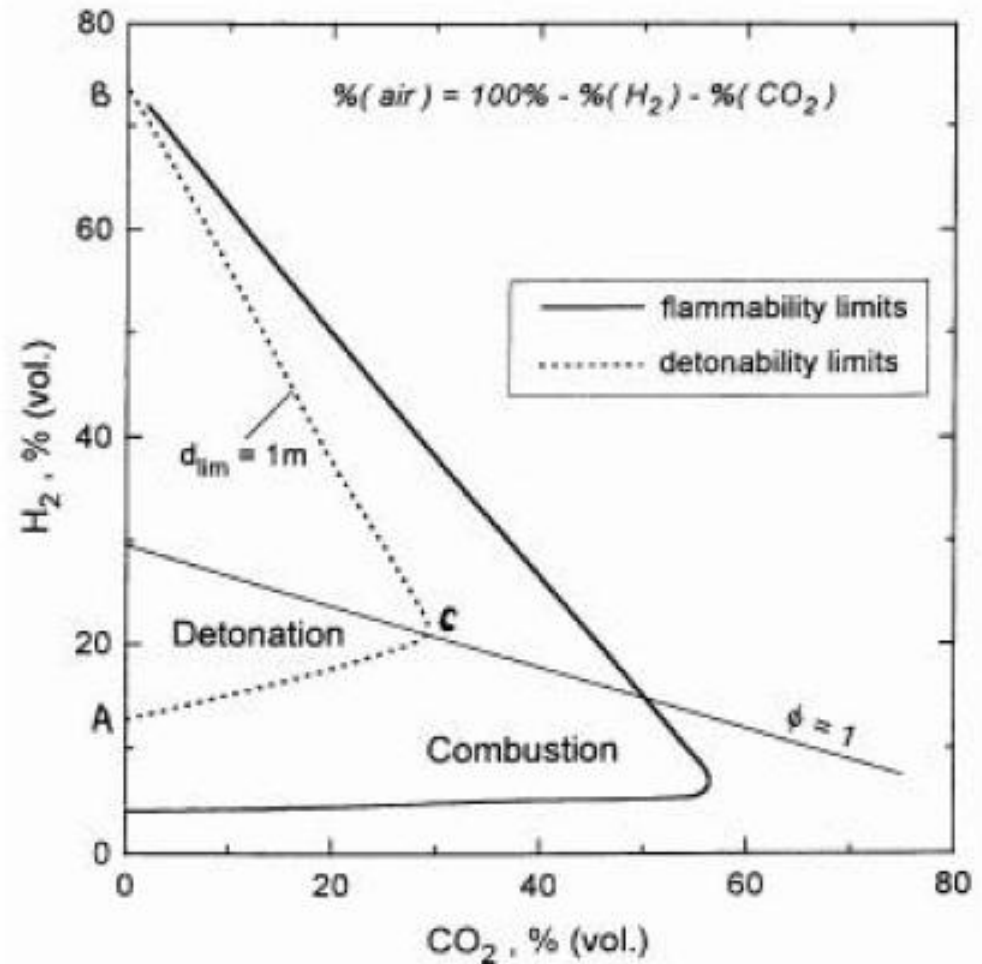

Source: Breitung, W et al. (2000) Flame acceleration and deflagration-to-detonation transition in nuclear society. NEA/CSNI Report No. NEA/CSNI/R(2000)7.

Effect of diluents on detonability limits (2/3)


- Effect of water addition on detonability range of hydrogen-air mixtures.
- Detonability range significantly reduced in the presence of water.
- A size of a pipe diameter also affects the detonability range

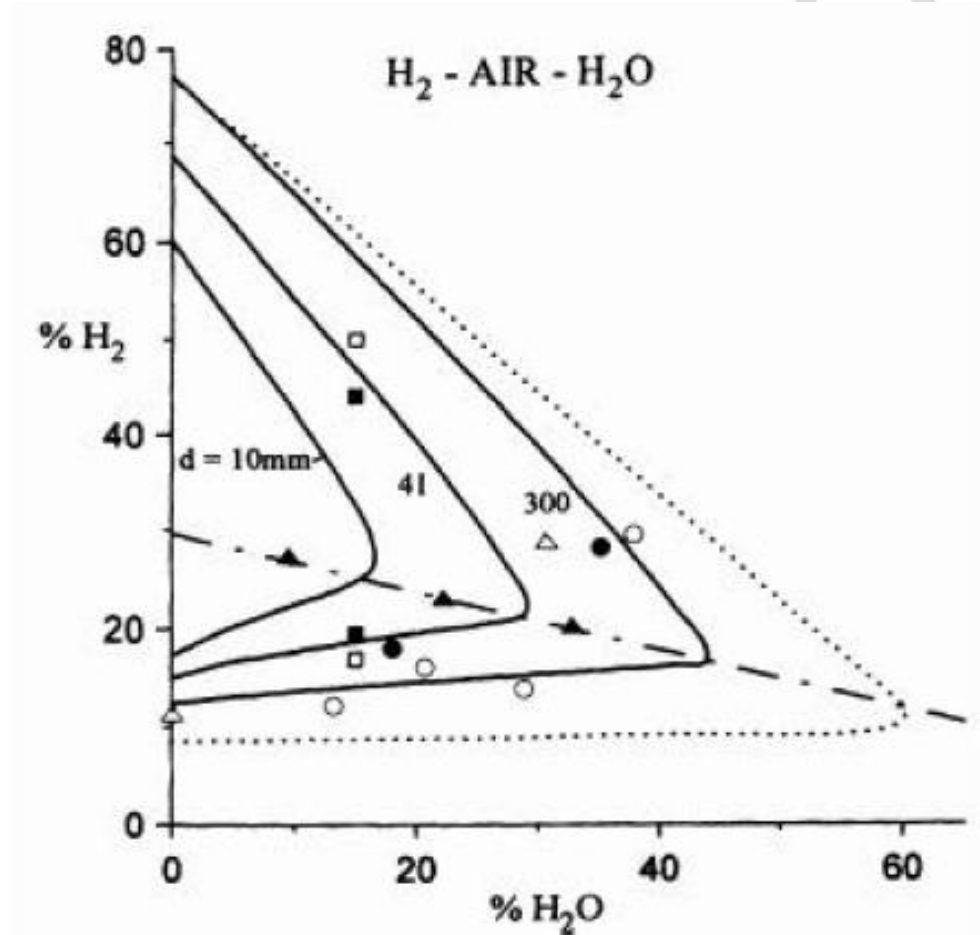

Source: Breitung, W et al. (2000) Flame acceleration and deflagration-to-detonation transition in nuclear society. NEA/CSNI Report No. NEA/CSNI/R(2000)7.

Effect of diluents on detonability limits (3/3)

- Effect of nitrogen N_2 addition on detonability limits of hydrogen-air mixtures.
- In the presence of nitrogen upper detonability limit greatly reduces as the concentration of diluent increases.
- Both LFL and LDL remain unchanged

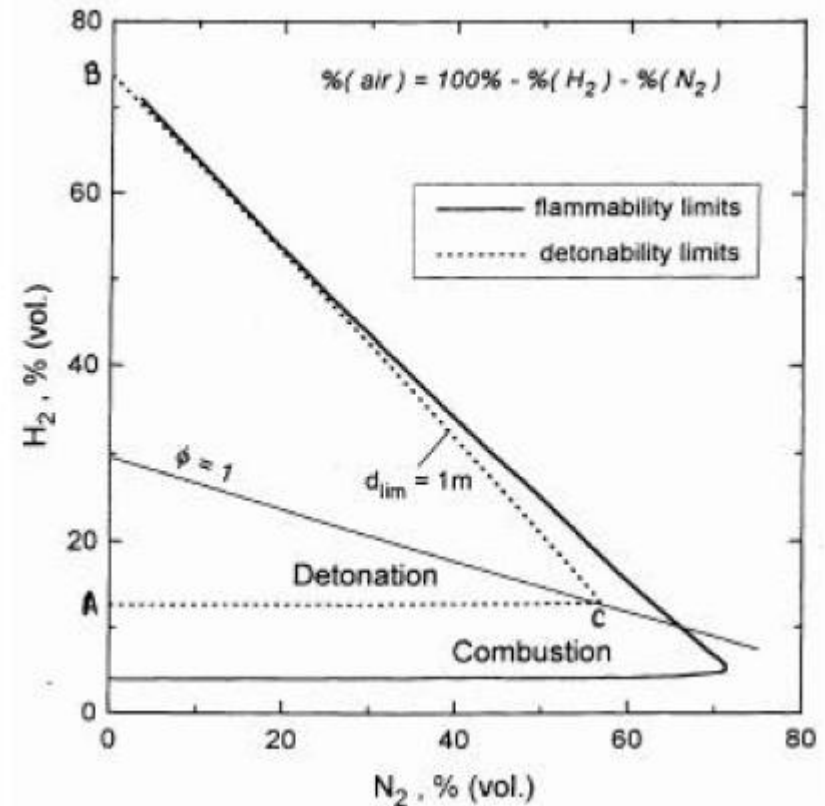


Direct initiation of detonations

- The ability of a hydrogen-air mixture to direct initiation of detonation is greater than that of hydrocarbons. The direct initiation of hydrogen-air mixture detonation is possible by 1.1 g of high explosive tetryl (BRHS, 2009). Only 1.86 g of high explosive TNT (trinitrotoluene) is needed to initiate detonation in 34.7 vol. % hydrogen-air mixture in the open atmosphere. However, for 20 vol. % hydrogen-air mixture the critical TNT charge increases significantly to 190 g (BRHS, 2009).
- For comparison, the release of energy during explosive reaction of 1 g TNT is arbitrarily standardized as 4.184 kJ (a gram of TNT releases 4.1-4.602 kJ upon explosion), and the lower heat of combustion of 1 g of hydrogen is equal to $(241.7 \text{ kJ/mol} / 2.016 \text{ g/mol}) = 119.89 \text{ kJ}$. Thus, the TNT equivalent of hydrogen is high: 28.65, i.e. 28.65 g of TNT is energetic equivalent of 1 g of hydrogen (BRHS, 2009).



Initiation of detonation

- For many hydrogen-oxygen compositions with no dilution, initiation by a spark (for example, 1-5 mJ) or flame source can produce a full detonation. In comparison, hydrogen-air mixture detonation requires essentially stronger initiation by at least a 1-2 g explosive charge.

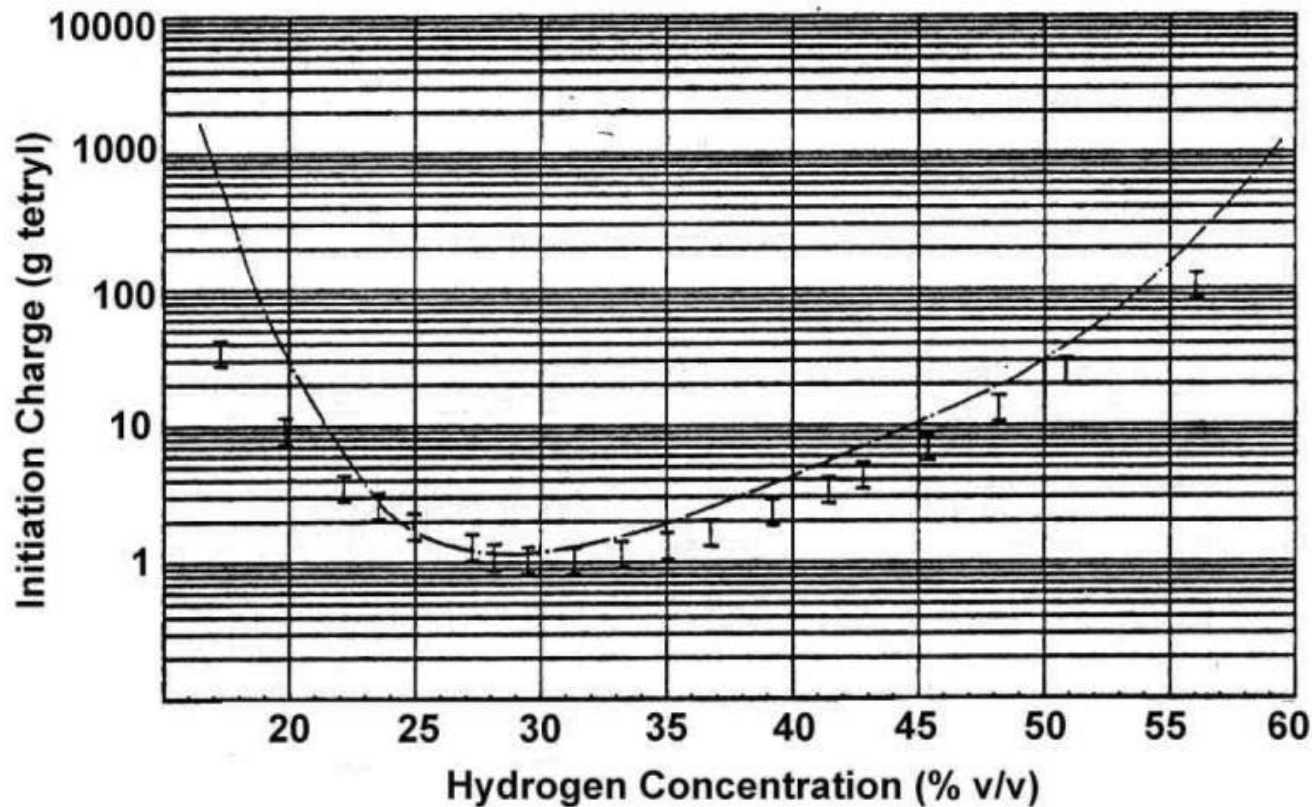


Minimum Ignition/Initiation Energy

The released/leaked hydrogen is very easily ignited. The MIE of GH_2 in air at NTP is 0.017 mJ. MIE for hydrogen is considerably less than that for methane (0.29 mJ) and petrol (0.24 mJ). Even a weak spark caused by a discharge of static electricity from a human body may be sufficient to ignite any of these fuels in air. The hydrogen-oxygen mixture could be ignited by the ignition energy as low as 0.0012 mJ.


Type of fuel	Minimum Ignition/Initiation Energy	
	Deflagration, mJ	Detonation, mJ
Hydrogen	0.017	10
Methane	0.25	230000
Propane	0.28	2500

Experiment in the open atmosphere

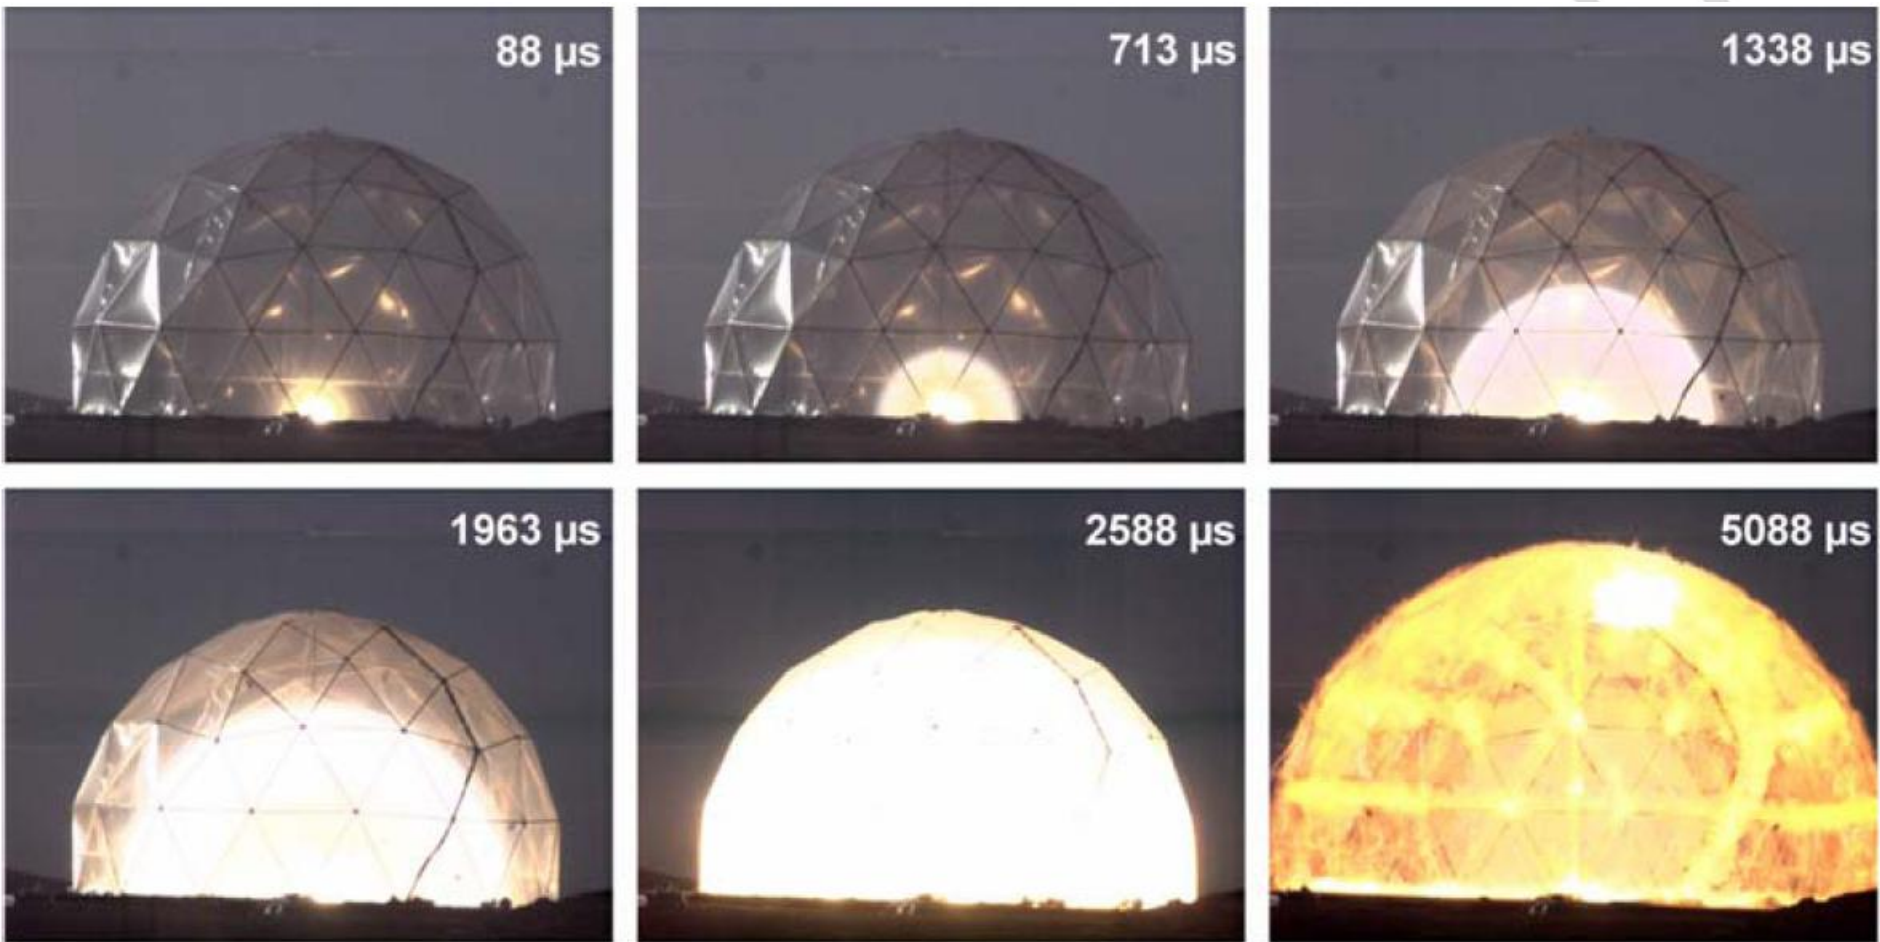


Groethe, M., et al. 1st ICHS: 30% hydrogen-air ($D_{CJ}=1980$ m/s, $H_c=3.2$ MJ/kg) in polyethylene balloon of radius $R=5.23$ m; Direct initiation; Blast wave overpressure was recorded at the radius $R=15.6$ m and the corresponding blast wave impulse was calculated.

Pressure dynamics at R=15.61 m

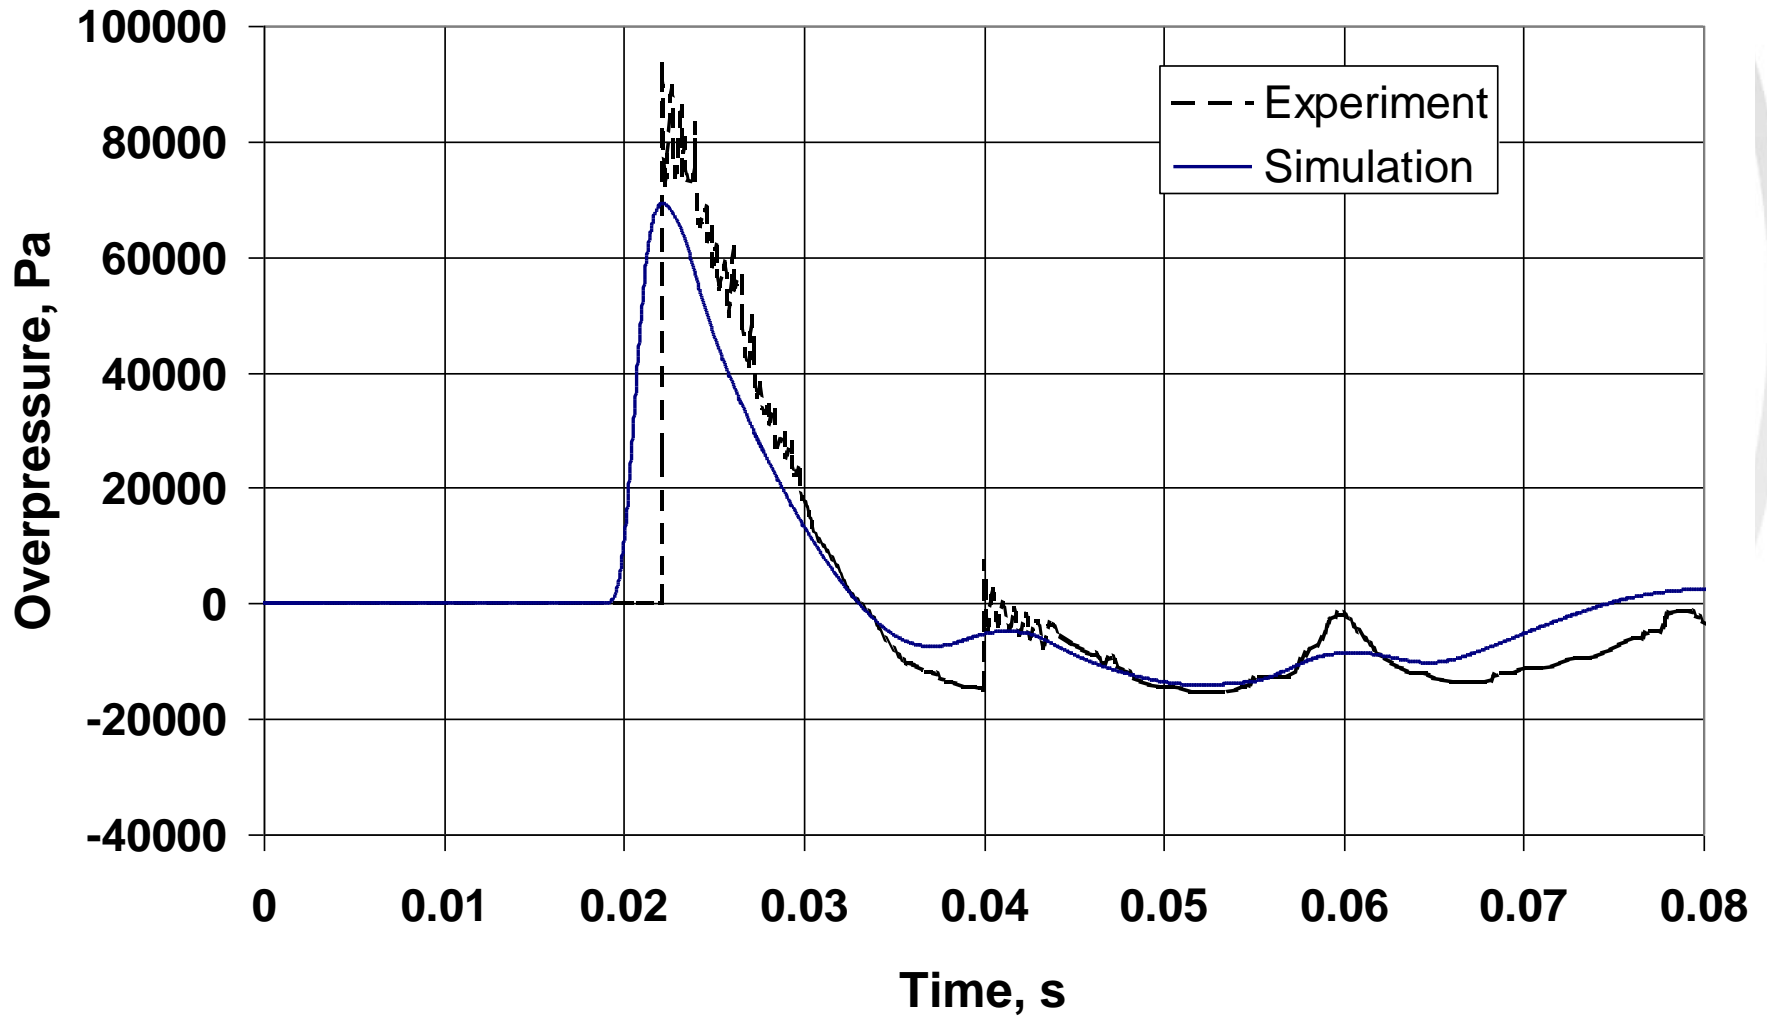

Impulse at R=15.61 m

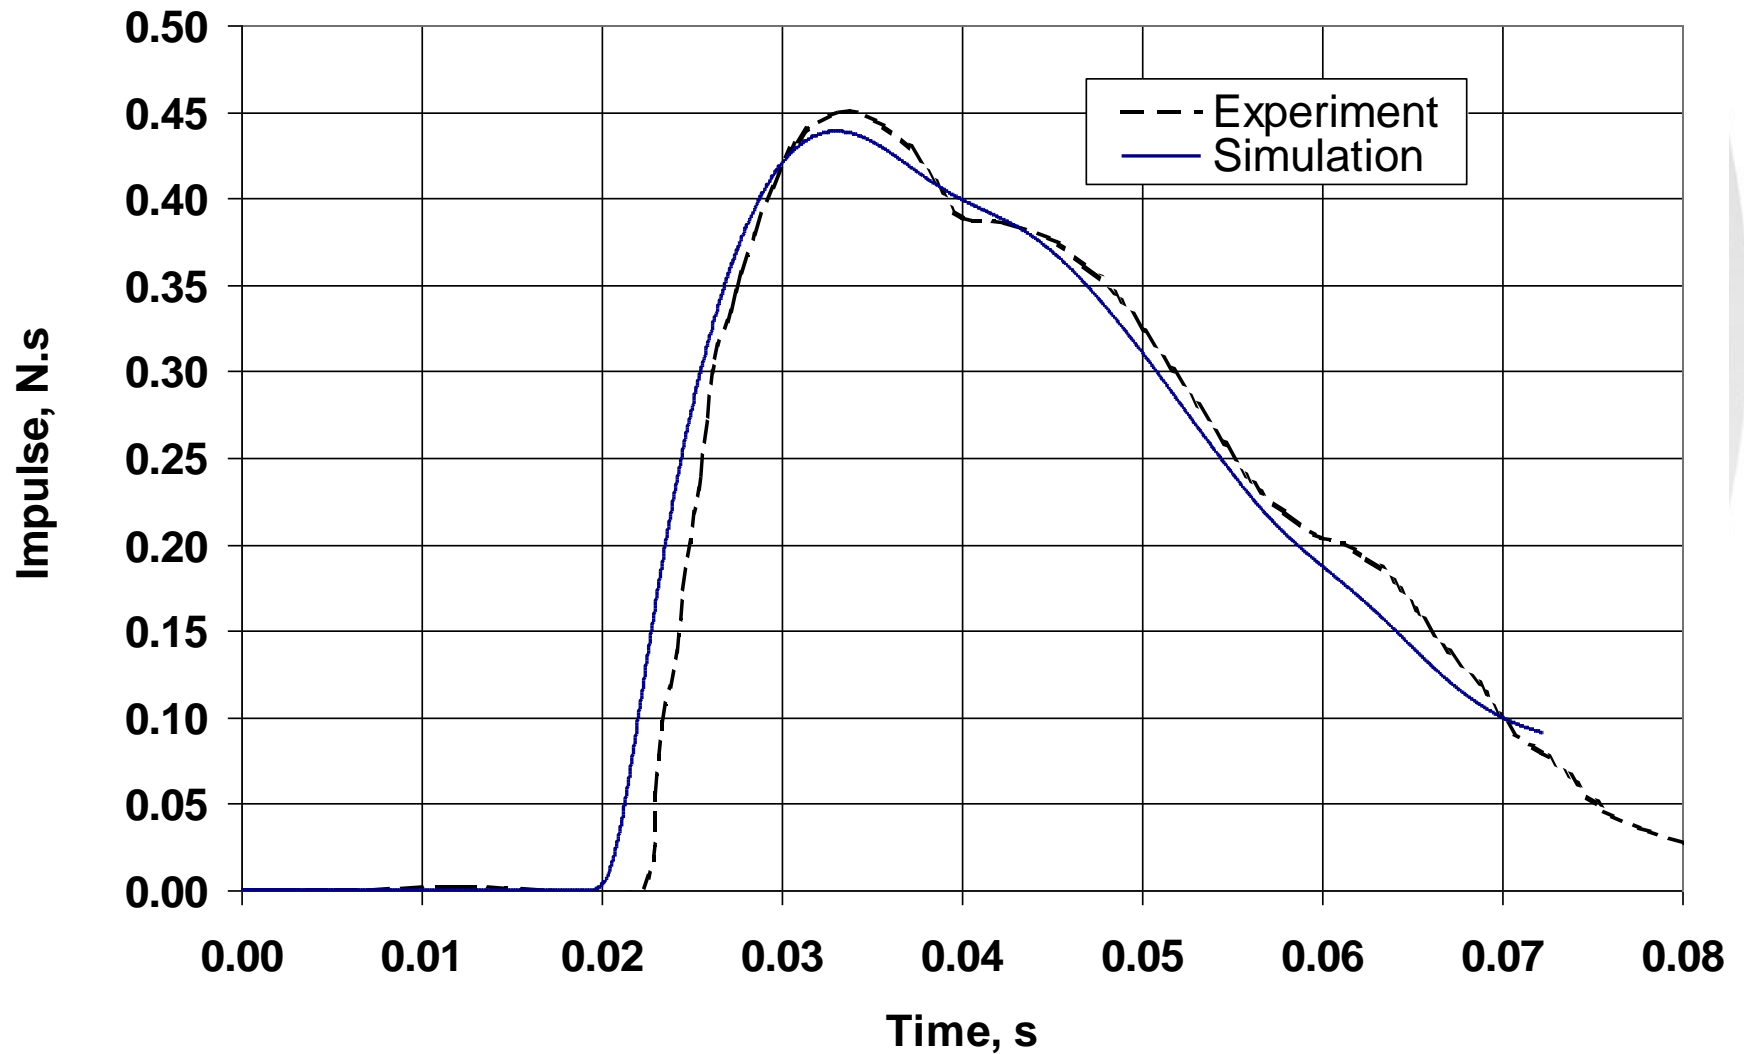

Effects of blast waves

- Damage to hearing
- Damage to lungs and other internal organs
- Injuries due to flying debris (e.g. glass shards)
- Collapse of structures on to people resulting in severe injuries or death
- A whole-body displacement of an individual
- It is not only overpressure that causes harm (please see Lecture on Harm criteria) but also impulse imparted on a person or object, where person is located and what personal equipment he/she wears.
- Note: impulse is the integral of pressure and time.



Rupture of a hydrogen storage tank in a fire




Threshold of overpressure: harm to humans

Harm criteria (selected thresholds)	Overpressure, kPa
1% fatality probability due to lung haemorrhage (Mannan, 2005): “fatality” hazard distance	100
1% eardrum rupture probability (Mannan, 2005): “injury” distance	16.5
Temporary threshold shift (Baker, 1983): “no harm” hazard distance (evacuation perimeter)	1.35


Blast wave: Evaluation of hazard distances

- For humans – from a rupture of a stand-alone tank in a fire

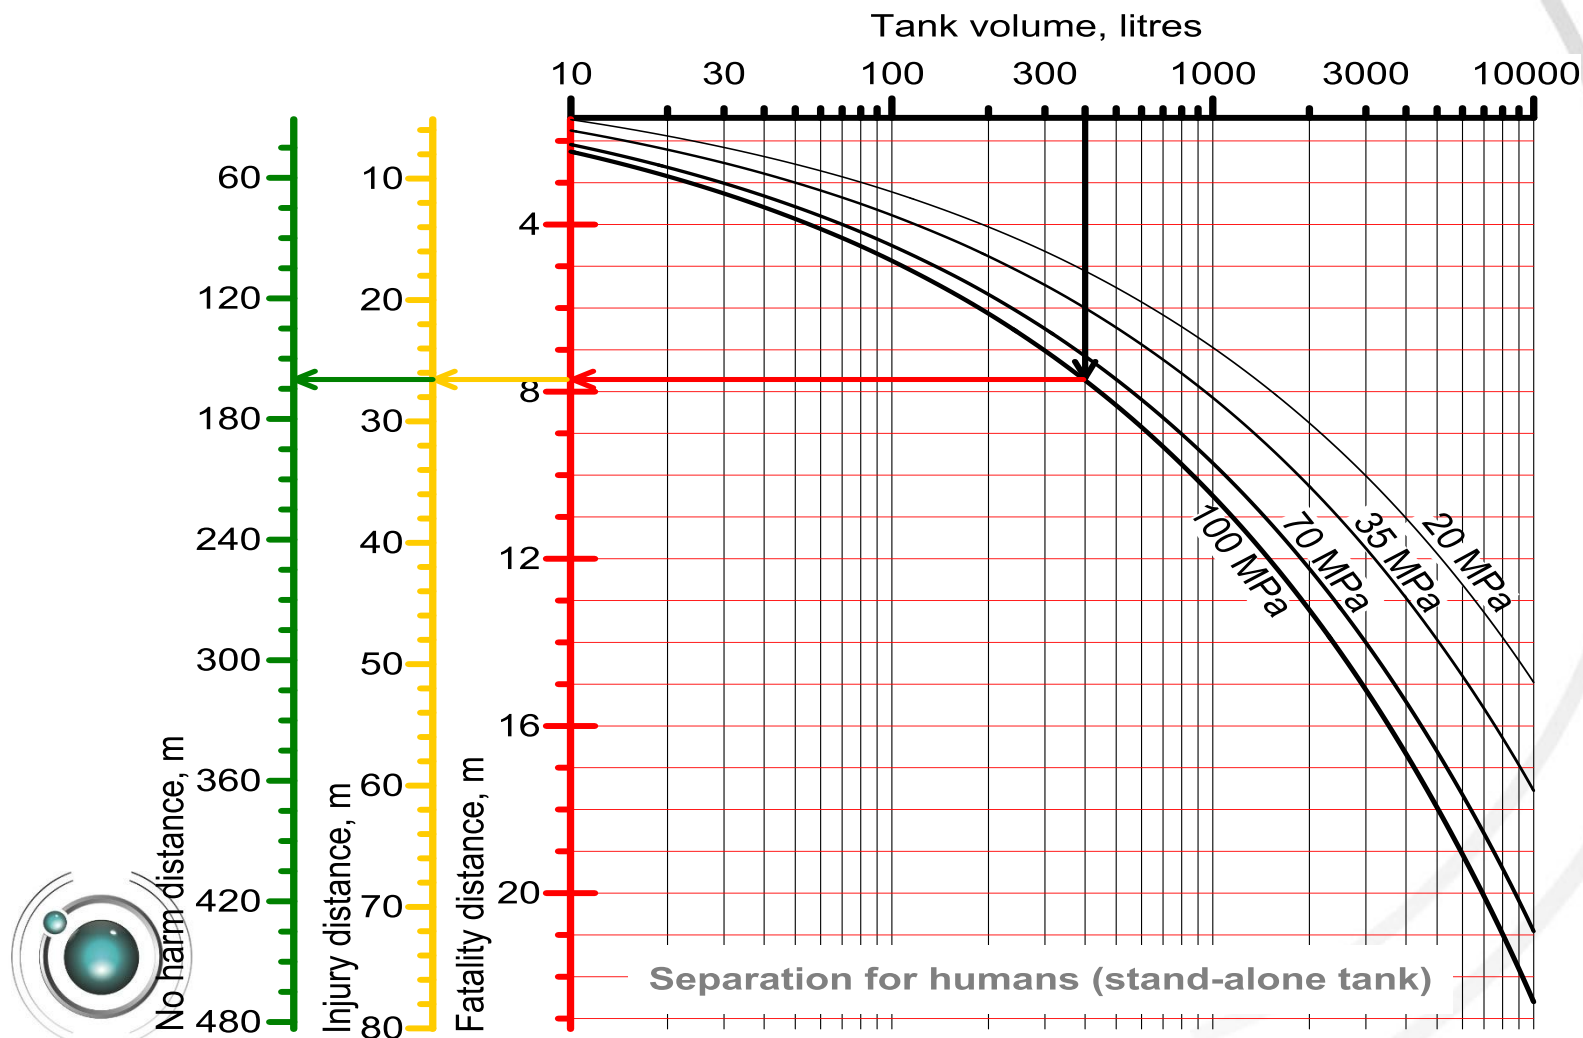

Blast wave: Evaluation of hazard distances

- For humans – from a rupture of an under-vehicle storage tank in a fire

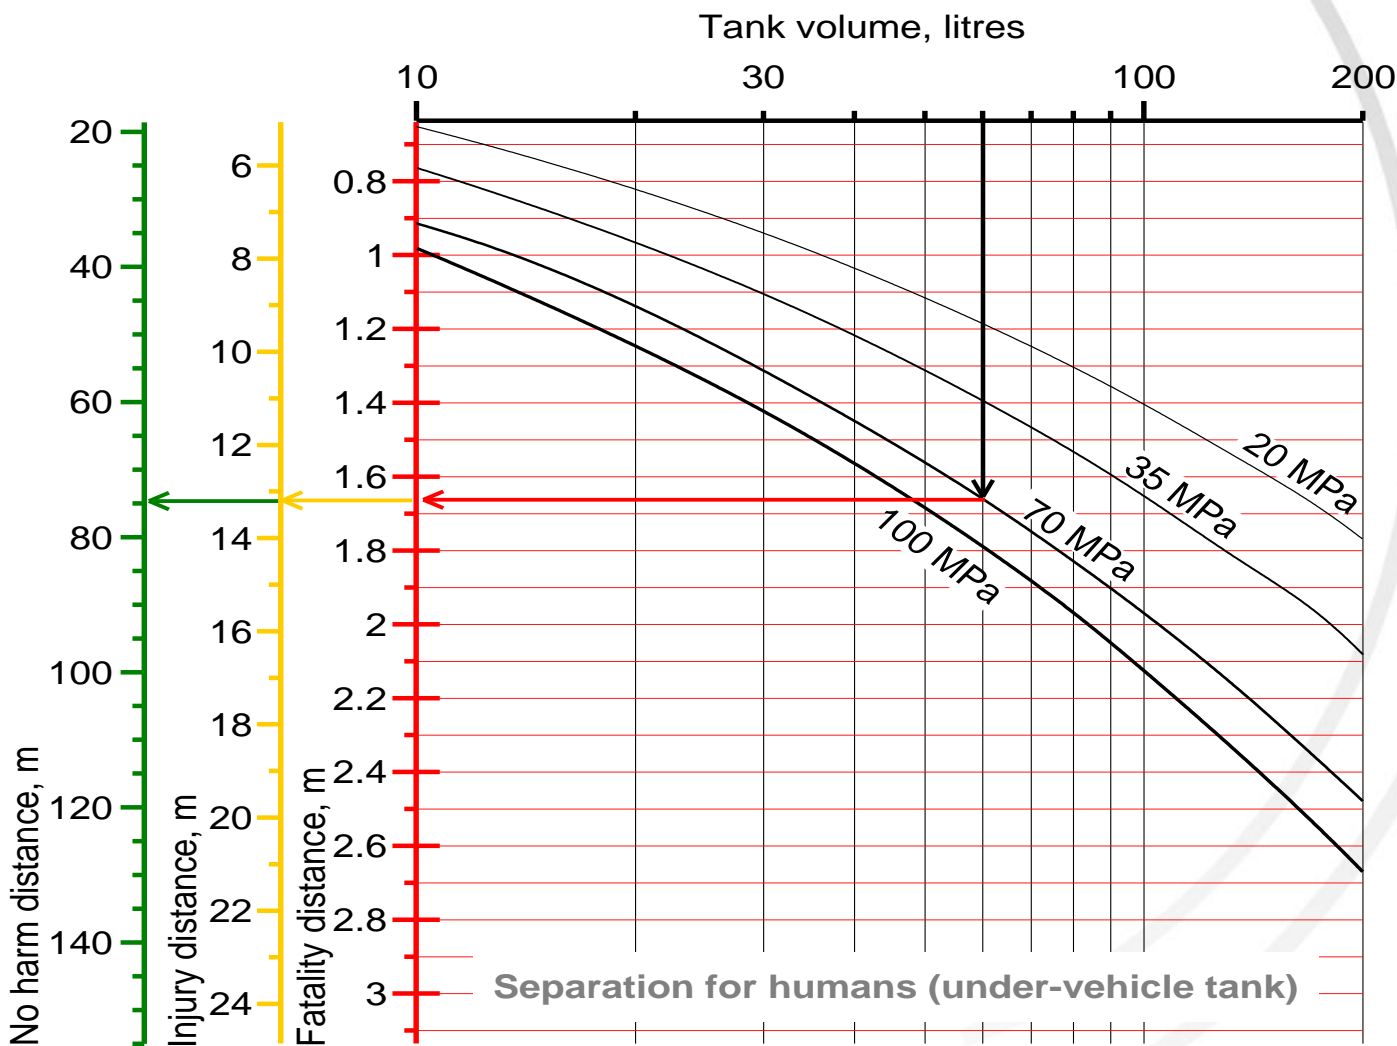


Threshold of overpressure: damage for buildings

Damage	Overpressure, kPa
Minor damage of the house (chosen as “minor damage”)	4.8
Partial demolition of the house-remains inhabitable (chosen as “partial demolition”)	6.9
Almost total destruction of the house (chosen as “almost total destruction”)	34.5-48.3

Source: Mannan, 2005


Blast wave: Evaluation of hazard distances

- For buildings – from a rupture of a stand-alone tank in a fire

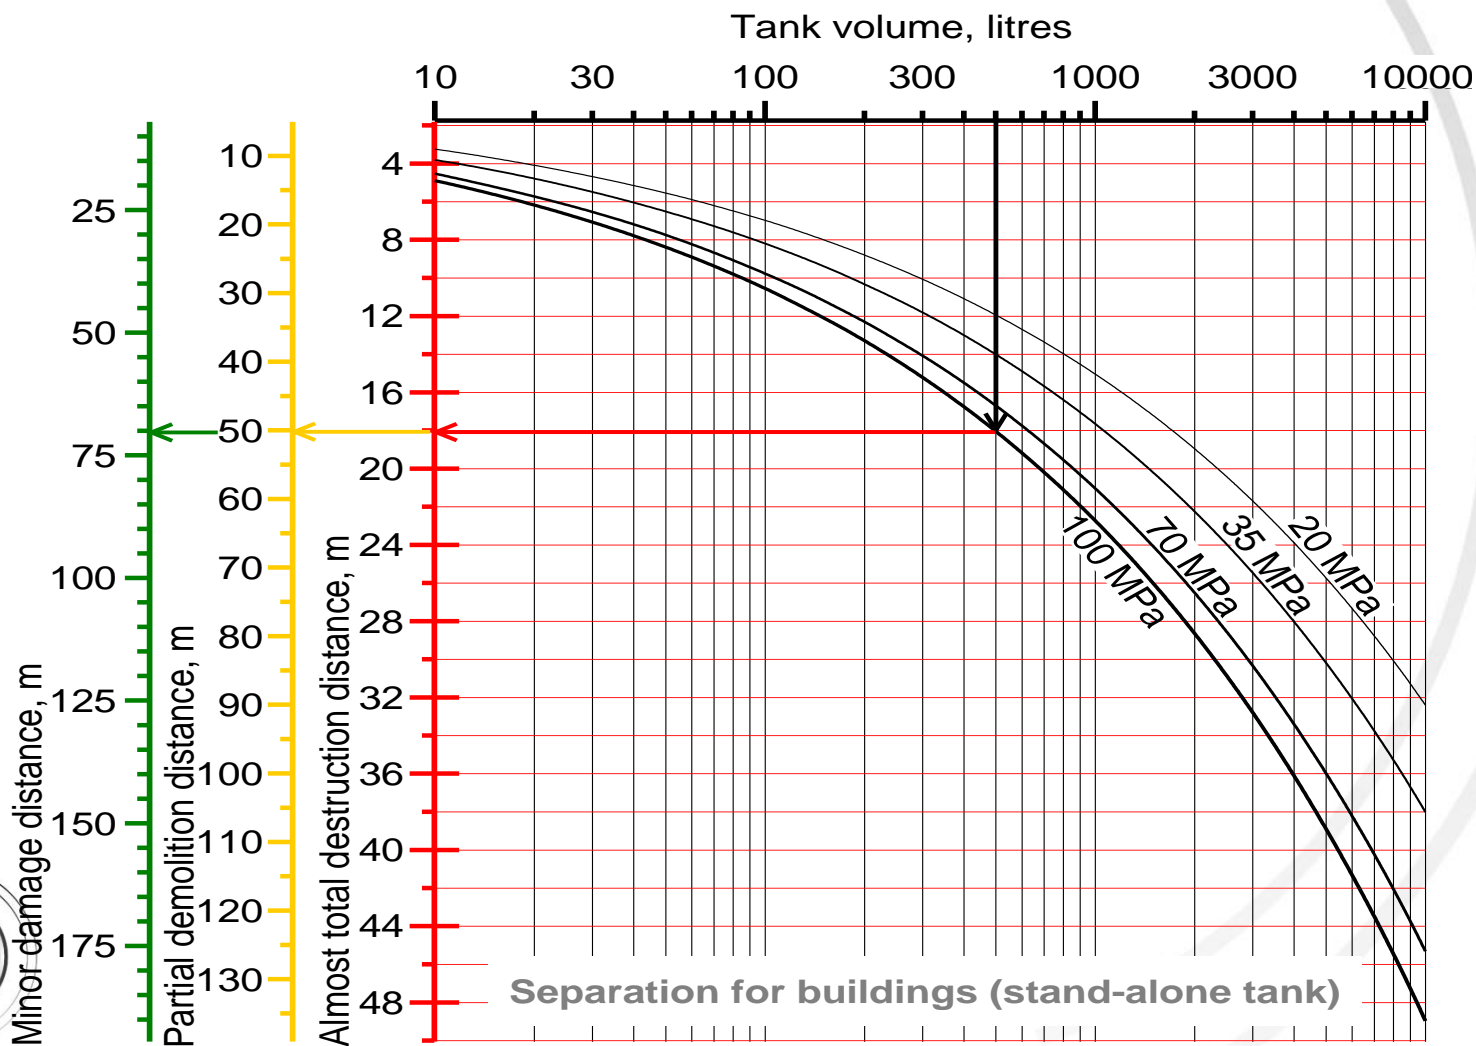

Blast wave: Evaluation of hazard distances

- For buildings – from a rupture of an under-vehicle storage tank in a fire

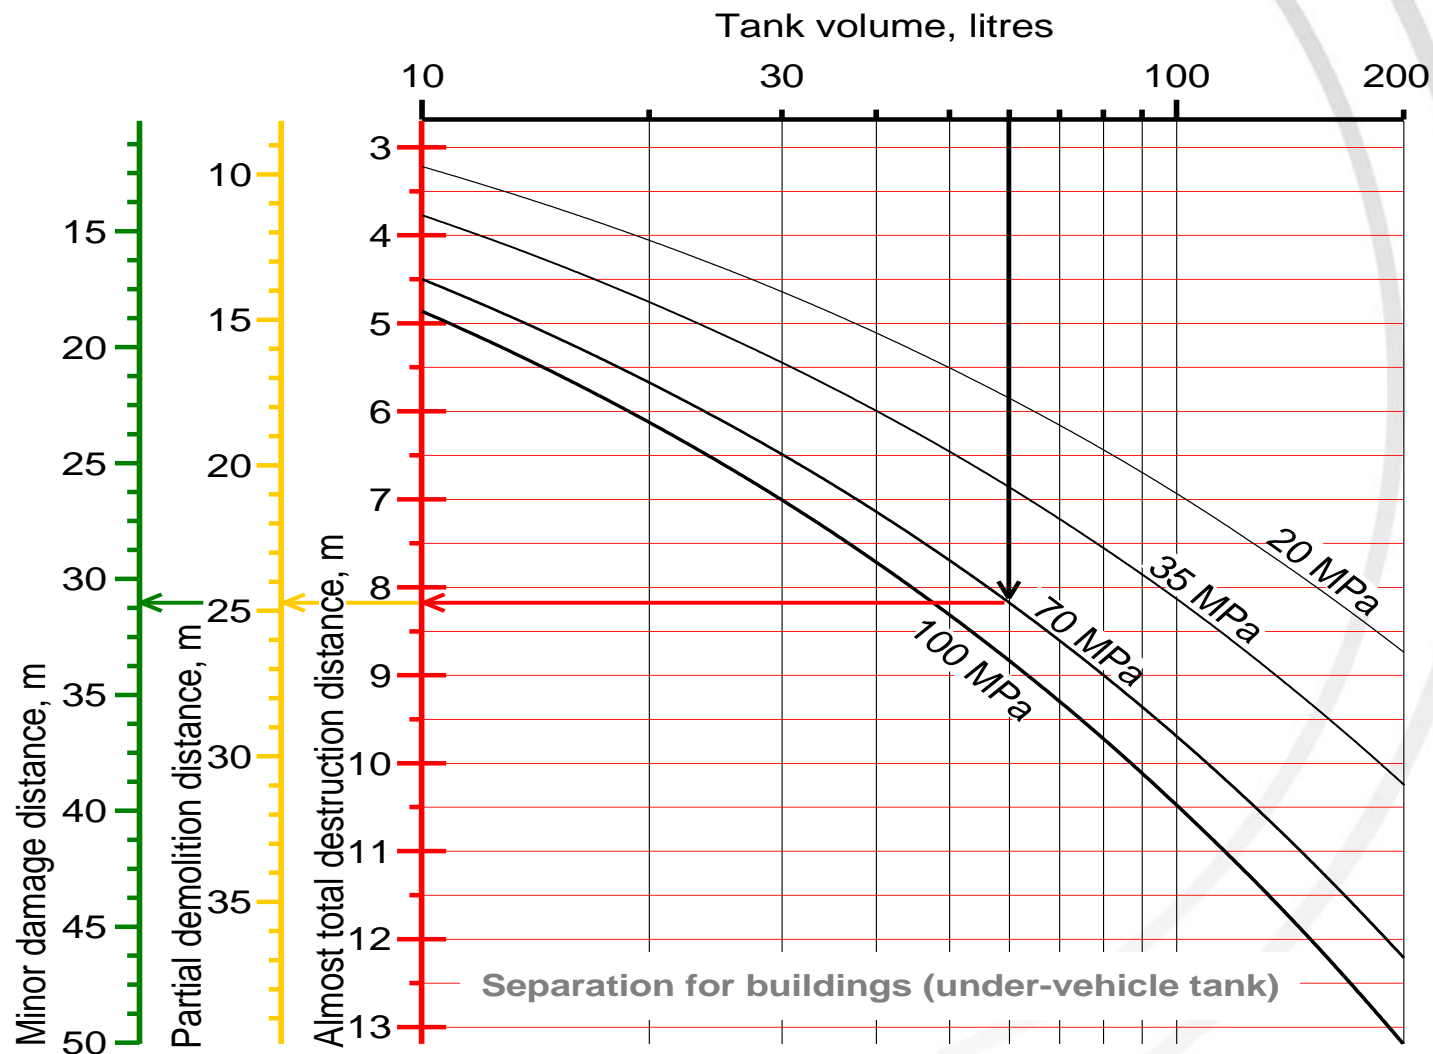

General prevention and mitigation measures

Prevention

Passive measures:

- Absence of ignition source(s)
- Avoid confined spaces if possible
- Natural ventilation

Active measures:

- Forced ventilation
- Detection and isolation

Mitigation

Passive measures:

- Deflagration venting
- Separation distances
- Barriers (see photo)

Active measures:

- Emergency response
- Detection
- Power shut-down



Mitigation of DDT

Strategies highlighted the standard ISO/TR 15916:2004 include:

- Avoid confinement and congestion where flammable hydrogen-air mixtures might form;
- Use flame arrestors, small orifices, or channels to prevent deflagration and detonation from propagating within a system;
- Use diluents, such as steam or carbon dioxide, or oxygen depletion techniques where possible and water spray or mist systems to retard flame acceleration. This recommendation of the standard should be taken with care as hydrogen-air flames are difficult to quench and they can burn or even accelerate around the droplets in heavy sprays of water (Shebeko et al., 1990);
- Reduce size of a system where possible to narrow detonability range.
- Knowing that hydrogen combustion is prone to DDT, especially at large scales, there are serious concerns on how technologies could be made safer. For such kind of applications, the safety strategy could be to organize and control the process of combustion of a hydrogen-contained mixture in a way that the mixture supplied to the burner is between the LFL and the LDL.

Prevention of DDT for FC

- Experiments of Pro-Science (Germany), mock-up of fuel cell (FC). A **significant flame acceleration** was recorded leading to a high overpressure, for the total injected mass of 15 g and 25 g, sufficient for complete demolition of the experimental rig. Both experimental and numerical studies of the FC mock-up suggest that **the total injected mass should be less than 6 g** for the configuration studied in order to keep overpressures below 10 to 20 kPa. Missile effects could be still possible for this 6 g inventory. Thus, **an inventory of 1 g** seems a good target for safety for accidental release within this FC mock-up (Friedrich et al., 2009).
- The feed line pressure and diameter of a pipe and restrictor orifice should, by design, limit the mass flow rate of hydrogen to a technological level that is required for the FC to function. The release duration, due to the time required to detect the leak and operate the valve should be reduced as much as possible to exclude release of more than 1 g of hydrogen. An estimate shows that for a **50 kW FC**, that needs **consumption rate of hydrogen just below 1 g/s**, **a leak detection time and time of shutting down supply line should be together less than 1 s**. Any reduction of this time would have a positive impact on safety.
- This requirement is difficult to achieve for currently available sensors. Innovative systems of leak detection, e.g. based on supply pressure fluctuation analysis, have to be developed and implemented to provide acceptable level of safety. The grid obstacle, used in the Pro-Science experiments to mimic the congestion within real fuel cell, led to strong flame acceleration (Friedrich et al., 2009). The congestion of internal space of the FC enclosure should be avoided as much as possible by a careful design.

References (1/4)

- Molkov, V (2012). Fundamentals of hydrogen safety engineering, Part I and Part II. Available from: www.bookboon.com, free download e-book.
- Dorofeev, SB (2007). Evaluation of safety distances related to unconfined hydrogen explosions. *International Journal of Hydrogen Energy*. Vol. 32, pp. 2118-2124.
- NFPA, National Fire Protection Association (2009). Compressed Natural Gas (CNG) Vehicular Fuel Systems Code, 52.
- Chapman, DL (1899). On the rate of explosion in gases. *Philosophical Magazine*. Vol. 47, pp. 90-104.
- Jouguet, JCE (1905-1906). On the propagation of chemical reactions in gases. *Journal des Mathématiques Pures et Appliquées*, vol. 1, pp. 347-425, 1905; continued vol. 2, pp. 5-85, 1906.
- Alcock, JL, Shirvill, LC and Cracknell, RF (2001). Comparison of existing safety data on hydrogen and comparative fuels. Deliverable report of European FP5 project EIHP2, May 2001. Available from: http://www.eihp.org/public/documents/CompilationExistingSafetyData_on_H2_and_ComparativeFuels_S..pdf [accessed on 13.05.14].
- Jordan, T (2008). Overview of hydrogen and fuel cell technologies. 1st ISCARW "Progress in Hydrogen Safety", September 2008, University of Ulster, Belfast
- Pförtner, H and Schneider, H (1983). Fraunhofer-institut für treib- und explosivstoffe. ICT-Projektforchung 19/83. Forschungsprogramm "Prozeßgasfreisetzung - Explosion in der Gasfabrik und Auswirkungen von Druckwellen auf das Containment". Ballonversuche zur Untersuchung der Deflagration von Wasserstoff/Luft-Gemischen (Abschlußbericht). Dezember 1983.
- Molkov, V, Makarov, D and Schneider, H (2006). LES modelling of an unconfined large-scale hydrogen-air deflagration. *Journal of Physics D: Applied Physics*. Vol. 39, pp. 4366-4376.
- Molkov, VV, Makarov, DV, Verbecke, F and Schneider, H (2007). Supra LES of accelerating premixed hydrogen-air flames in the open atmosphere. *Proceedings of the 3rd International Symposium on Non-Equilibrium Processes, Plasma, Combustion and Atmospheric Phenomena (NEPCAP)*, Sochi, Russia, June 2007.
- Gorev, VA, Miroshnikov, SN and Troshin, YaK (1980) Pressure waves from gaseous explosions. In: *Detonation, Proceedings of the VI All-Union Symposium on Combustion and Explosions*, (23-26 September 1980, Almaty), Chernogolovka, Institute of Chemical Physics of Academy of Sciences of USSR, 1980, pp.110-113.
- Molkov, VV (2009). A multi-phenomena turbulent burning velocity model for large eddy simulation of premixed combustion. In: *Nonequilibrium Phenomena: Plasma, Combustion, Atmosphere*. Eds. Roy GD, Frolov SM and Starik AM, Torus Press, Moscow, pp. 315-323.
- Verbecke, F, Makarov, D and Molkov, V (2009). VLES of lean hydrogen-air deflagrations in a closed 5.7m height vessel. 6th Mediterranean Combustion Symposium, Ajaccio, France.
- Kumar, RK and Bowles, EM (1990) Flame acceleration in hydrogen/air mixtures in a vertical cylinder filled with obstacles. *Proceedings of the 2nd Int. Conf. on Containment Design and Operation*, Toronto, Canadian Nuclear Society, 14-17 October 1990.
- Whitehouse, DR, Greig, DR and Koroll, GW (1996). Combustion of stratified hydrogen-air mixtures in the 10.7 m³ combustion test facility cylinder. *Nuclear Engineering and Design*. Vol. 166, 453-462.


References (2/4)

- Dorofeev, SB (2008). Flame acceleration and transition to detonation: a framework for estimating potential explosion hazards in hydrogen mixtures. *Lecture presented at the 3rd European Summer School on Hydrogen Safety*, Belfast, UK, 21-30 July 2008.
- Ciccarelli, G and Dorofeev, S (2008). Flame acceleration and transition to detonation in ducts. *Progress in Energy and Combustion Science*. Vol. 34, pp. 499–550.
- Bradley, D (1999). Instabilities and flame speeds in large-scale premixed gaseous explosions. *Phil. Trans. R. Soc. Lond. A*. Vol. 357, pp. 3567-3581.
- Bradley, D, Cresswell, TM and Puttock, JS (2001). Flame acceleration due to flame-induced instabilities in large-scale explosions. *Combustion and Flame*. Vol. 124, pp. 551-559.
- Lipatnikov, AN (2007). Turbulent combustion of hydrogen-air mixtures. *Lecture presented at the 2nd European Summer School on Hydrogen Safety*, Belfast, UK, 30 Jul – 8 Aug 2007.
- Lipatnikov, AN and Chomiak, J (2005). Molecular transport effects on turbulent flame propagation and structure. *Progress in Energy and Combustion Science*, vol. 31, pp. 1-73.
- Kuznetsov, VR and Sabelnikov, VA (1990). *Turbulence and Combustion*. Hemisphere Publishing Corporation. 1st edition.
- Groethe, M, Merilo, E, Colton, J, Chiba, S, Sato, Y and Iwabuchi, H (2005). Large-scale hydrogen deflagrations and detonations, *Proceedings of the 1st International Conference on Hydrogen Safety*, 8-10 September 2005, Pisa, Paper 120105.
- Molkov, V, Verbecke, F and Makarov, D (2008). LES of hydrogen-air deflagrations in a 78.5 m tunnel. *Combustion Science and Technology*. Vol. 180 (5), pp. 796-808.
- Gamezo, VN, Ogawa, T and Oran, ES (2007). Numerical simulations of flame propagation and DDT in obstructed channels filled with hydrogen-air mixture. *Proc. Comb. Inst.* Vol. 31, pp. 2463-2471.
- Landau, LD and Lifshits, EM (1988) *Hydrodynamics*, Nauka, Moscow, p.733.
- NFPA 68 (2007) *Guide for venting of deflagrations*, NFPA, Quincy, MA, USA.
- Molkov, V, Verbecke, F, and Saffers, JB. (2008). Venting of uniform hydrogen-air deflagrations in enclosures and tunnels: vent sizing and prediction of overpressure. 7th ISHPMIE, St. Petersburg, Russia, July 7–11, 2008.
- EN14994:2007. *Gas explosion venting protective systems*.
- Lamoureux, N, Djebaili-Chaumeix, N and Paillard, C-E (2003). Laminar flame velocity determination for H₂-air-He-CO₂ mixtures using the spherical bomb. *Experimental Thermal and Fluid Science*. Vol. 27, pp. 385-393.



References (3/4)

- Tse, SD, Zhu, DL and Law, CK (2000). Morphology and burning rates of expanding spherical flames in H₂/O₂/inert mixtures up to 60 atmospheres. Proceedings of the 28th Symposium (International) on Combustion, Pittsburgh, PA: The Combustion Institute, pp. 1793-1800.
- Babkin, VS (2003). Private communication. Institute of Chemical Kinetics and Combustion, Siberian Branch, Russian Academy of Science, Novosibirsk, Russia.
- Pasman, HL, Groothuizen, ThM and de Gooijer, H (1974). Design of pressure relief vents. *In: Loss Prevention and Safety Promotion in the Process Industries*, Ed. by C.H. Buschman, pp. 185-189.
- HyIndoor. Deliverable D5.1. "Guidelines on fuel cell indoor installation and use", www.hyindoor.eu
- Friedrich, A, Grune, J, Jordan, T, Kotchourko, A, Kotchourko, N, Kuznetsov, M, Sempert, K, Stern, G (2007). Experimental study of hydrogen-air deflagrations in flat layer, Intl. Conf. on Hydrogen Safety, 11 – 13 September 2007, San Sebastian, Spain.
- BRHS, Biennial Report on Hydrogen Safety (2009). The European network of excellence "Safety of hydrogen as an energy carrier" (NoE HySafe). Available from: www.hysafe.org [accessed on 13.05.14].
- Zbikowski, M, Makarov, D and Molkov, V (2008). LES model of large scale hydrogen–air planar detonations: Verification by the ZND theory. *International Journal of Hydrogen Energy*. Vol. 33, pp. 4884-4892.
- Dorofeev, SB, Bezmelnitsin, AV and Sidorov, VP (1995). Transition to detonation in vented hydrogen-air explosions. *Combustion and Flame*. Vol. 103, pp. 243-246.
- Tsuruda, T and Hirano, T (1987). Growth of flame front turbulence during flame propagation across an obstacle. *Comb. Sci. Techn.* Vol. 51, pp. 323-328.
- Pfortner, H and Schneider, H (1984) Final Report for Interatom GmbH, Bergish Gladbach, Germany, October, Fraunhofer ICT Internal Report. (in German).
- Kuznetsov, M. et al (2005). DDT in a smooth tube filled with a hydrogen-oxygen mixture. *Shock Waves*. Vol. 14(3), pp. 205-215.
- NASA (1997). Safety standard for hydrogen and hydrogen systems. Guidelines for hydrogen system design, materials selection, operations, storage, and transportation. Technical report NSS 1740.16, Office of safety and mission assurance, Washington. Available from: <http://www.hq.nasa.gov/office/codeq/doctree/canceled/871916.pdf> was cancelled on July 25 2005 [accessed 13.05.14].
- ISO/TR 15916 (2004). Basic considerations for the safety of hydrogen systems. International Organization for Standardization. ISO Technical Committee 197 Hydrogen Technologies. International Organization for Standardization, Geneva.
- Tieszen, SR, Sherman, MP, Benedick, WB, Shepherd, JE, Knystautas, R and Lee, JHS (1986). Detonation cell size measurements in hydrogen-air-steam mixtures. *Progress in Astronautics Aeronautics*. Vol. 106, pp. 205–219.
- Lewis, B and von Elbe, G (1987). Combustion, flames and explosions of gases. 3rd edition. Academic, Press.



References (4/4)

- Breitung, W et al. (2000). Flame acceleration and deflagration-to-detonation transition in nuclear society. NEA/CSNI Report No. NEA/CSNI/R(2000)7.
- Radulescu, MI, Sharpe, GJ and Law, CK (2005). The Hydrodynamic Structure of Detonations. *Proceedings of the 20th ICDEERS*, Montreal, Canada 2005.
- Bull, DC, Ellworth, JE and Shiff, PJ (1982). Detonation Cell Structures in Fuel/Air Mixtures. *Combustion and Flame*. Vol. 45(1), pp. 7-22.
- Lee, JHS (1982). Hydrogen air detonations. *2nd International workshop on the impact of hydrogen on water reactor safety*. Albuquerque, New Mexico.
- Gavrikov, AI, Efimenko, AA and Dorofeev, SB (2000). A model for detonation cell size prediction from chemical kinetics. *Combustion and Flame*. Vol. 120, pp. 19-33.
- Rigas, F and Amyotte, P (2013). Hydrogen safety. Boca Raton: CRC press. Taylor and Francis Group.
- Cassut, LH (1961). Experimental investigation of detonation in unconfined gaseous hydrogen-oxygen-nitrogen mixtures. *ARS Journal*. Vol. 31, p.7.
- Lee, JH, Kynstantus, RC, Guirao, M, Benedick, WA and Shepherd, JE (1982). Hydrogen-Air Detonations. *Proceedings of the 2nd International Workshop on the Impact of Hydrogen on Water Reactor Safety*. M. Berman, Ed., SAND82-2456, Sandia National Laboratories, Albuquerque, NM, October.
- Browne, S and Shepherd, JE (2007). Linear Stability of Detonations with Reversible Chemical Reactions. Extended abstract and work-in-progress poster for the 21st International Colloquium on the Dynamics of Explosions and Reactive Systems, ENSMA, Poitiers, France, July 22-27, 2007
- HyFacts Project. Chapter DM. Hydrogen deflagrations and detonations. Available from: <http://hyfacts.eu/category/education-training/> [accessed on 04.01.16].
- Molkov, V and Kashkarov, S (2015). Blast wave from a high-pressure gas tank rupture in a fire: stand-alone and under-vehicle hydrogen tanks. *International Journal of Hydrogen Energy*. Vol. 40, no. 36, pp. 12581–12603.
- Baker, WE, Cox, PA, Westine, PS, Kulesz, JJ and Strehlow, RA (1983). *Explosion hazards and evaluation*. Elsevier Scientific Publishing Company.
- Mannan, S (2005). *Lees' Loss Prevention in the Process Industries*, 3rd ed., vol. 1. Elsevier Butterworth-Heinemann.
- Shebeko, YuN, Tsarichenko, S G, Eremenko, OYa, Keller, VD and Trunev, AV (1990). Combustion of lean hydrogen-air mixtures in an atomized water stream. *Combustion Explosion and Shock Waves*. Vol. 26(4), pp. 426-428.
- Friedrich, A, Kotchourko, N, Stern, G and Vesper, A (2009). HYPER experiments on catastrophic hydrogen releases inside a fuel cell enclosure. *Proceedings of the Third International Conference on Hydrogen Safety*, Paper ID 118, 16-18 September 2009, Ajaccio, Corsica, France.
- Crowl, DA (2003). *Understanding explosions*.